

Chapter 1200-1-6
Subsurface Sewage Disposal

Amendments

Rules 1200-1-6-.01 through 1200-1-6-.22, Regulations To Govern Subsurface Sewage Disposal Systems, are amended by deleting them in their entirety and substituting the following to read as follows:

Rules
Of
Department of Environment and Conservation
Division of Ground Water Protection

Chapter 1200-1-6
Regulations to Govern Subsurface Sewage Disposal Systems

Table of Contents

1200-1-6-.01	Definitions		
1200-1-6-.02	Subdivisions	1200-1-6-.16	Privies and Composting Toilets
1200-1-6-.03	Additional Site Requirements and Limitations for Subdivision Approval And Issuance of Construction Permit		
1200-1-6-.04	Percolation Test Procedures	1200-1-6-.17	Approved Soil Consultants
1200-1-6-.05	Construction Permit		
1200-1-6-.06	Design of Conventional Disposal Field	1200-1-6-.18	Installer of Subsurface Sewage Disposal Systems
1200-1-6-.07	Septic Tank Capacity		
1200-1-6-.08	Design of Septic Tanks	1200-1-6-.19	Septic Tank Pumping Contractor
1200-1-6-.09	Effluent Treatment Devices/Systems		
1200-1-6-.10	Location of Septic Tanks, Dosing Chambers and Absorption Fields	1200-1-6-.20	Domestic Septage Disposal
1200-1-6-.11	Design of Dosing Systems	1200-1-6-.21	Fees for Services
1200-1-6-.12	Maintenance of the Subsurface Sewage Disposal System	1200-1-6-.22	General Provisions
1200-1-6-.13	Grease Traps		
1200-1-6-.14	Alternative Methods of Subsurface Sewage Disposal		
1200-1-6-.15	Experimental Methods of Treatment and Disposal other Than Those in These Regulations		
1200-1-6-.01	DEFINITIONS.		

Accessible Community Sewer means a public sewer system not limited for use because of physical or other features as determined by the Commissioner.

Alternative/Experimental Methods of Disposal means a subsurface sewage disposal system, the construction, installation and operation of which varies from that of a conventional subsurface sewage disposal system.

Blockout means a potential access hole which is a thin section of concrete preformed in a septic tank which can be removed to allow insertion of a four (4) to six (6) inch diameter pipe.

Boundary Outline means a map or chart with lines delineating the boundaries of the proposed area or parcel of land.

Buffer Zone means the distance between subsurface sewage disposal systems or subsystems required to alleviate the impact of hydraulic overloading from the adjacent system(s).

Commissioner means the Commissioner of the Department of Environment and Conservation, his duly authorized representative, and in the event of his absence or a vacancy in the Office of Commissioner, the Deputy Commissioner.

Conventional Sand Filter means a filter with two (2) feet or more of medium sand designed to chemically and biologically process septic tank or other treatment unit effluent from a pressure distribution system operated on an intermittent basis.

Conventional Subsurface Sewage Disposal System means a system that pretreats sewage by use of a septic tank and applies effluent to the soil as described in Rule 1200-1-6-.06.

Department means the Tennessee Department of Environment and Conservation.

Disposal Field means the part of a subsurface sewage disposal system that utilizes the soil for absorption and treatment of septic tank effluent.

Domestic Septage means either liquid or solid material removed from a septic tank, cesspool, portable toilet, Type III marine sanitation device, or similar treatment works that receive only domestic sewage. Domestic septage does not include liquid or solid material removed from a septic tank, cesspool, or similar treatment works that receives either commercial wastewater or industrial wastewater and does not include grease removed from a grease trap at a restaurant.

Dosing Chamber means a watertight receptacle which houses a sewage effluent pump and stores sewage effluent from a septic tank until it is pumped to a disposal field.

Effluent Filter means an effluent treatment device installed on the outlet of a septic tank or dosing tank which is designed to prevent the passage of large suspended matter.

Filled Land means areas to which more than two (2) feet of soil and/or debris have been added.

Graded Land means areas from which soil has been removed and the remaining soil cannot be classified in any soil series.

Grease means animal fats or vegetable oils (resulting from food preparation) which are discharged to a sewage disposal system or accumulated in collection devices or traps that are associated with sewage disposal systems, conduits, sewers, plumbing fixtures and attachments. However, this definition shall exclude petroleum products, lubricants, silicones and greases of mineral or synthetic origin.

Grease Trap means a device designed to intercept and retain grease present in sewage or other wastewater.

Gullied Land means areas where gullies occupy nearly all of the surface area. Areas in which gullies occur within spacial intervals of less than one hundred (100) feet shall be classified as a soil gullied land complex. Gullies of more than one hundred (100) feet spatial intervals shall be located on the soil maps with the designated symbols.

Gully means a miniature valley (more than one foot in depth) cut by running water and through which water generally runs during and shortly after rainfall. Gullies are intermittent stream channels.

Installer of Subsurface Sewage Disposal Systems means a person who contracts or otherwise installs, constructs, alters or extends a subsurface sewage disposal system.

Lot means a part of a subdivision or a parcel of land intended for the building of a single house, building, or other development where a subsurface sewage disposal system is to be used.

Miscellaneous Land Types means areas on the earth's surface that are non-soil (rocks, water, etc) and soils that are difficult or impossible to classify in soil series (filled land, graded land, gullied land, paved areas, etc.)

Percolation Rate means the rate at which water moves into the soil as determined by a percolation test.

Percolation Test means a method of determining the usability of an area for subsurface sewage disposal by testing for the rate at which the undisturbed soil in a series of test holes of standard size will absorb water per unit of surface area.

Person means any and all persons, including individuals, firms, partnerships, associations, public or private institutions, municipalities, or political subdivisions or officers thereof, departments, agencies, or instrumentalities, or public or private corporation or officers thereof, organized or existing under the laws of this or any other state or country.

Permit means a written authorization issued by the Commissioner licensing one of the following: the construction, alteration, extension, or repair of a subsurface sewage disposal system, or the removal and disposal of accumulated wastes from subsurface sewage disposal systems, and including those engaged in such businesses.

Plans means any documents required by the Commissioner in the process of carrying out these Regulations. Plans may include, but not be limited to: applications, boundary outlines, plats, soil maps and topographic maps.

Plat means a map or other graphic representation drawn to scale, of a piece of land subdivided into lots, showing streets, waterlines, lot lines, etc.

Positive Drainage Plan means a plan by which all free water, both surface and subsurface, is removed from an area (lot, subdivision, etc.) by gravity, (even acquiring off-site easements where necessary).

Privy means a structure and/or excavation for the disposal of human excreta by non-water carriage methods.

Public Sewerage System means the conduits, sewers, and all devices and appurtenances by means of which sewage is collected, pumped, treated and disposed of; all of which are owned and operated by a municipality, utility district or other legally constituted agency of government.

Recirculating Gravel Filter (RGF) means a type of gravel filter wastewater treatment system which utilizes an effluent recycle system where a portion of the filtered effluent is mixed with septic tank effluent in a recirculation/dilution tank and redistributed to the filter.

Relief Line means a closed pipe laid on an undisturbed section of ground that conveys septic tank effluent from one trench to a subsequent trench on a lower elevation.

Restriction means a limitation on the use of properties where subsurface sewage disposal systems are proposed.

Restrictive Covenant means that document which restricts the use of property by its owner and specifies the obligations and responsibility of the owner regarding the property.

Rill means a small shallow (one foot or less in depth) ephemeral channel that carries water only during and for a few minutes after rainfall. Rills can be obliterated with conventional farm tillage implements.

Septage means a combination of organic sludge, liquid and scum which accumulates in septic tanks.

Septic Tank means a watertight receptacle which receives the discharge of sewage and is designed and so constructed so as to permit settling of solids from the liquid, digestion of organic matter by detention, retention of the floating solids, and discharge of the liquid portion.

Septic Tank Effluent means partially treated sewage which is discharged from a septic tank.

Septic Tank Pumping Contractor means any person engaged in the business of removing or disposing of the sludge and liquid contents of septic tanks or holding tanks.

Sewage means human excreta, all water carried wastes, and household wastes from residences, buildings, or commercial and industrial establishments.

Sink means a closed depression in an area of karst topography, that is formed either by the solution of the surficial limestone or by the collapse of underlying caves. Its form varies from basin-like to funnel shaped and its size varies from only a few feet across to several hundred feet across. The bottom of a sink most commonly consists of soil formed of materials which rolled or washed from the surrounding area and has slopes, which are generally, nearly level to undulating.

Slope or Grade means the rate of fall or rise of a pipeline or of the ground surface in reference to the horizontal plane.

Soil Absorption Rate means the rate, in minutes per inch, that clean water is absorbed by or drains through a soil during least favorable climatic conditions when soils are at or near field capacity. Estimated absorption rates are established in Appendix 1 for soil series and phases of soil series that have been recognized in Tennessee. For soil series and phases that have been recognized but not listed in Appendix 1 the Department shall establish the rate. Estimated soil absorption rates for variants of soil series and miscellaneous land types may be established by an approved soil consultant; however, those rates may be established by the Department.

Soil Evaluation means the systematic examination of soils in the field and/or in laboratories, their description and classification, the mapping of kinds of soils or miscellaneous areas showing the distribution of soils in relation to the physical, cultural and special features of the earth's surface and the interpretation of the soils and site characteristics for their suitability for subsurface sewage disposal or to determine if the areas are eligible for percolation tests. The mapping is either general, high intensity or extra high intensity.

Soil Incorporation means the disking or plowing of the soil at a domestic septage disposal site, within six (6) hours of land application of domestic septage, so that no domestic septage is present on the surface of the soil.

Soil Injection means the injection of domestic septage below the surface of the soil.

Soil Map means a map showing the size, shape and distribution of the various kinds of soil in relation to other physical and cultural features on the earth's surface.

- (a) There are three (3) kinds of soil maps. They are general, high intensity and extra high intensity. They are defined as follows:

- (b) General – A general is a second order survey as defined in the Soil Survey Manual, United States Department of Agriculture, October 1993. These surveys are made for intensive land use that require detailed information. Map units shall be named at a categorical level above the soil series. Miscellaneous land types or interpretative groupings of soils such as those in which percolation tests are allowed for subsurface sewage disposal site evaluation shall be delineated. Map scale shall be one (1) inch equals one hundred (100) feet. Minimum size map unit delineations shall be twenty-five hundred (2500) square feet. The mapping legend shall be provided by the Department.
- (c) High Intensity – A first order survey as defined in the Soil Survey Manual, United States Department of Agriculture, October 1993. These surveys are made for very intensive land use that require very detailed soils information that require very precise knowledge of soils and their variability such as individual building sites. Field procedures require observation of soil boundaries throughout their length. Map units are mostly soil series, phases of soil series with some complexes and miscellaneous land areas. Some map units named at categorical level above the series are allowed. Map scale shall be one (1) inch equals one hundred (100) feet. Minimum size delineation shall be six hundred twenty-five (625) square feet.
- (d) Extra High Intensity – A map that is the same as a high intensity soil map except the scale may be one (1) inch equals one hundred (100) feet or one (1) inch equals fifty (50) feet. The minimum size delineation shall be one hundred (100) square feet. These maps have more cartographic detail than high intensity maps.

Soil Map Unit means an abstract model of a soil taxonomic unit or miscellaneous land type that has a set of distinguishing soil characteristics that set it apart from all other soil map units.

Soil Map Unit Delineation means an area on a soil map that represents a kind of soil or miscellaneous land type that occupies an area on the earth's surface. There may be several map unit delineations of one soil map unit.

Soil Series means a group of very similar soils that have one or more soil characteristics that distinguishes that soil from all other soil series. As used in these Regulations, a soil series is one that has been recognized by the Natural Resource Conservation Service in Tennessee.

Soil Taxadjunct means soil that has one or more distinguishing soil characteristics that prevents that soil from being classified in any soil series that has been recognized in Tennessee by the National Cooperative Soil Survey. A taxadjunct to a soil series does not differ enough to require different use and management or to expect different behavior from the named soil to which it is adjunct.

Soil Variant means a soil that has one or more distinguishing soil characteristics and soil properties that prevent that soil from being classified in any soil series that has been recognized by the National Cooperative Soil Survey in Tennessee. A soil variant requires use and management significantly different from the soil from which the variant is named. Also, behavior different from the soil series for which the variant is named can be expected.

Spring means a point where water naturally issues from the ground surface.

Storage Facility means a receptacle, which is designed to receive and retain septage prior to disposal, when the disposal site is not accessible.

Subdivision means any tract or parcel of land divided into two (2) or more lots, sites or other division for the purpose of immediate or future building of dwellings, buildings or other mobile or permanent structures where subsurface sewage disposal systems are to be used. Subdivision does not include a division of any

tract or parcel of land into two (2) or more tracts or parcels when such parts are five (5) acres or larger in size.

Subsurface Sewage Disposal System means a system, other than a public or community system, which receives sewage. Included within the scope of this definition are: septic tank absorption systems, privies, chemical toilets, and other similar systems. However, a subsurface sewage disposal system does not include a sewerage system regulated under T.C.A. Sections 68-221-101 et. seq. and 68-3-101 et. seq.

Swelling means a condition caused by the intrusion of water into the individual clay particles.

Topographic Map means a map showing existing physical features, with contour lines at sufficient intervals to permit determination of proposed grades and drainage.

Vicinity Map means a map, which indicates the region near or about a place and the proximity to prominent and established landmarks.

Water Table means that level below which the soil or rock is saturated with water.

Authority: T.C.A. §68-221-403, 4-5 et seq. Administrative History: Original rule certified June 7, 1974. Amendment filed December 1, 1974; effective December 30, 1975. Amendment filed December 21, 1989; effective February 4, 1990. Amendment filed January 9, 1991; effective February 23, 1991. Amendment filed June 1, 1994; effective August 15, 1994. Amendment filed February 3, 1997; effective April 19, 1997. Amendment filed _____, effective _____.

1200-1-6-.02 SUBDIVISIONS.

- (1) Approval by Other Agencies - No proposed subdivision shall be approved by the State Planning Office, a local or regional planning commission or other agency authorized to approve subdivisions until the plans for such subdivisions have been approved by the Commissioner.
- (2) Lot Size - Lots shall be large enough to construct the original subsurface sewage disposal system and to provide an area for duplication of that system. The area(s) for both original and duplicate systems shall meet the provisions of these Rules.
- (3) Evaluation and Lot Design - Either a High-Intensity or a General Soil Evaluation shall be conducted as described below.
 - (a) Soils Evaluation
 1. Mapping Procedures
 - (i) A high-intensity soil evaluation shall be made of the entire subdivision, the entire lot or a minimum of 20,000 square feet per lot. Each soil delineation shall be drawn and plotted using a scale of 1 inch to 100 feet. The soil mapping shall be done by a soil consultant approved by the department pursuant to the requirements of 1200-1-6-.17. Two (2) copies of such map shall be submitted to the Commissioner.
 - (ii) A general soil evaluation map shall be made of the entire subdivision using a standard mapping legend provided by the department and each soil delineation shall be drawn and plotted using a scale of one (1) inch to one hundred (100) feet. The soil mapping shall be done by a soil consultant approved

by the department pursuant to the requirements of Rule 1200-1-6-.17. Two (2) copies of such map shall be submitted to the Commissioner. Soil delineations based on slopes, soil depth to rock and water problems shall be identified on the map. Each delineation appearing on the plat map through soil evaluation shall be interpreted by the soil consultants in terms of eligibility for percolation tests.

2. When the services of a soil consultant are provided by the department, three (3) copies of a plat of the site drawn to a scale of one (1) inch equals one hundred (100) feet shall be submitted to the Commissioner. The site shall be either grid staked or lots staked as follows:

(i) A one hundred (100) feet master-grid system with surveyed control stakes numbered at not more than five hundred (500) feet intervals and the location of the same on the plat. The ratio of precision of the unadjusted survey shall be a minimum of 1:1000. The plat shall show the seal and signature of the surveyor and show a bar scale. Intermediate grid stakes with numbers at not more than one hundred (100) feet intervals shall be numbered and shown on the plat. The intermediate stakes may be set by rough chaining or other methods to a lesser degree of accuracy, however, said intermediate stakes shall be within two (2) feet of the distance shown. The Commissioner may require the removal of vegetative growth such as weeds, vines and briars to permit access to all parts of the property. In wooded areas cut/flagged lines shall be maintained until the property is evaluated.

(ii) Staked lots must have a numbered surveyed stake at each corner. The ratio of precision of the unadjusted survey shall be a minimum of 1:1000. The plat shall show the seal and signature of the surveyor and show a bar scale. Intermediate ground control stakes shall be numbered and set in areas where lot corners are not visible from any point on the lot. The intermediate stakes must be set no more than two hundred (200) feet apart, and said intermediate stakes may be set by rough chaining or other methods to a lesser degree of accuracy, however, said stakes shall be within two (2) feet of the distance shown on the plat. The Commissioner may require the removal of vegetative growth such as weeds, vines, and briars to permit access to all parts of the property. In wooded areas cut/flagged lines shall be maintained until property is mapped.

3. When the service of a private soil consultant is utilized, then the requirements in 1200- 1-6-.02(3)(a)2.(i) or (ii) shall apply.

(b) Percolation Test

1. Under authority of T.C.A. Section 68-221-403(c), after a general or high intensity soil evaluation has been conducted by an approved soil consultant and the soils are found to have the following characteristics, then a percolation test may be conducted pursuant to Rule 1200-1-6-.04.

- (i) There shall be a minimum depth of twenty-four (24) inches of undisturbed soil.
- (ii) Slopes of more than thirty (30) percent do not qualify for percolation tests unless provisions of Rule 1200-1-6-.03(4)(d) are met.
- (iii) No water problem shall exist. A water problem shall be considered to exist if any of the conditions are present as listed in the Soils Handbook.

2. Where a percolation test is required to determine the percolation rate for a conventional system, the percolation holes used to determine this rate must be located at the intersection of lines in a grid pattern with maximum perpendicular distances of fifty (50) feet between the lines of the grid. Each hole shall be considered reasonably representative of a square area of two thousand five hundred (2,500) square feet which includes that hole in the approximate center of the square; or

Where a percolation test is required to determine the percolation rate for an alternative system, the percolation holes used to determine this rate must be located at the intersection of lines in a grid pattern with maximum perpendicular distances of twenty-five (25) feet between the lines of the grid. Each hole shall be considered reasonably representative of a square area of six hundred twenty-five (625) square feet, which includes that hole in the approximate center of the square.

Where percolation tests are used to determine the rate at which water moves through the soil, the minimum lot size shall be twenty thousand (20,000) square feet where a public water supply is used or a minimum of twenty-five thousand (25,000) square feet where a private water supply is used. The department shall be notified at least three (3) days prior to the day that the percolation test will be conducted. Percolation test procedures may be monitored when deemed necessary.

- (i) Two (2) copies of the subdivision plat at a scale of one (1) inch equals one hundred (100) feet shall be submitted to the Commissioner. Such plat shall show percolation test holes identified by number and plotted to scale, subdivision boundaries and other pertinent topographic features. All lot and grid lines shall be drawn with appropriate numbers shown on the plat corresponding with survey stakes on the ground.
- (ii) Tabulated results of percolation test holes shall be reported on a form provided by the department.
- (iii) The actual average percolation rate shall be determined by averaging only the test results from the area actually to be covered by the permit, which includes both initial and duplicate area. Areas in which percolation test results were unfavorable shall be excluded. The average percolation rate shall be calculated on a weighted basis.

(iv) Percolation test results shall not be conclusive evidence as to the suitability of an area. Such tests shall be considered and analyzed as one of the many criteria in determining site suitability.

3. All percolation test locations shall adhere to the requirements of Rule 1200-1-6-.10(1).

(4) Construction Design

(a) Each lot shall be accurately surveyed and lot boundaries designated by survey stakes with lot numbers shown on said stakes.

(b) Three (3) copies of a subdivision plat at a scale of one (1) inch equals one hundred (100) feet shall be submitted to the Commissioner, which shall indicate:

1. Lot dimensions with all lots numbered.

2. Easements for any purpose.

3. Surface and underground drainage designed so as not to interfere with subsurface sewage disposal systems.

4. Positive drainage plan, where needed. A positive drainage outlet must be available for each lot before the final plat is signed. If construction of a positive outlet is necessary, all construction shall be done before final plat approval is given. Off property easements may be necessary.

5. Seal and signature of registered surveyor. (In order to survey and plat subdivisions an engineer, by law, must be a registered surveyor).

6. Precision of the unadjusted survey. A minimum ratio of precision of the unadjusted survey of 1:7,500 is required.

7. Vicinity map.

8. North arrow indicating magnetic north or otherwise and indicate the scale of the plat.

9. All final plats shall have distances on all lines and shall indicate the identity of all corners such as steel post, concrete or iron pin.

(c) The submittals required under Rules 1200-1-6-.02(3) and 1200-1-6-.02(4) may be combined into one (1) submittal to the Commissioner.

(d) After review of the site and information submitted, the Commissioner shall:

1. Approve in writing the subdivision as proposed, or

2. Recommend in writing the corrections needed to receive approval, or

3. Indicate in writing that the proposed subdivision or areas therein are not suitable with reasons therefore.

(e) Where revisions are made to the construction design, revised plats shall be submitted to the Commissioner.

(5) Additional Data

Whenever the data required in these rules are insufficient to determine suitability of an individual lot or subdivision, additional data may be required by the Commissioner.

(6) Final Approval

(a) Two (2) copies of the final plat shall be submitted to the Commissioner with permanent lot lines drawn and the information required in Rule 1200-1-6-.02(3)(a) or 1200-1-6-.02(3)(b) and Rule 1200-1-6-.02(4). Additional plats for recording purposes without soil delineation, contour lines and percolation test hole locations may be submitted for approval.

(b) The maximum wastewater flow or maximum number of bedrooms for each lot shall be shown on the plat.

(c) Any subdivision plat may be subject to restrictions as determined by the Commissioner and such restrictions shall be recorded on or appended to the plat. This may include designation of primary and duplicate areas or soil area to be reserved for subsurface sewage disposal systems.

(d) The Commissioner may approve a plat by attaching an appropriate signature after all provisions of these Rules are met.

(e) Before any changes or restrictions can be made or removed, a revised plat must be submitted to the Commissioner prior to approval. If the approved plat has been recorded at the county register of deeds office, any modifications will require rescission of the existing approved plat.

(7) Individually owned lots in unapproved subdivisions shall meet the requirements of this rule with the exception that only one copy of each plat shall be submitted to the Commissioner, with the plat representing only the individual lot. Where a plat of the unapproved subdivision has been recorded, this rule shall only apply to those subdivisions recorded after June 30, 1995.

Authority: T.C.A. §68-221-403, 4-5 et seq. Administrative History: Original rule certified June 7, 1974. Amendment filed December 1, 1974; effective December 30, 1975. Amendment filed July 12, 1976; effective August 11, 1976. Amendment filed May 17, 1978; effective June 16, 1978. Amendment filed December 21, 1989; effective February 4, 1990. Amendment filed January 9, 1991; effective February 23, 1991. Amendment filed September 3, 1991; effective October 18, 1991. Amendment filed June 1, 1994; effective August 15, 1994. Amendment filed February 3, 1997; effective April 19, 1997. Amendment filed December 27, 2000; effective March 12, 2001. Amendment filed _____, effective _____.

1200-1-6-.03 ADDITIONAL SITE REQUIREMENTS AND LIMITATIONS FOR SUBDIVISION APPROVAL AND INDIVIDUAL LOTS AND ISSUANCE OF CONSTRUCTION PERMIT.

(1) Suitability of Site - Prior to the design of subsurface sewage disposal systems, the suitability of the site must be demonstrated through acceptable soil absorption rates, acceptable soil conditions, freedom from groundwater interference or slowly permeable strata below the level of the disposal field, and other topographic characteristics. For lots which are not part of a subdivision as defined herein, the Commissioner may determine

site suitability, acceptable soil absorptions rates, acceptable soil conditions, freedom from groundwater interference or impervious strata below the level of the disposal field, and other topographic characteristics. For lots which are not part of a subdivision as defined herein, where the services of a soil consultant are utilized, then the requirements established in Rule 1200-1-6-.02(3)(a) of these Regulations may apply as deemed necessary by the department either on an area basis or site specific basis.

- (2) Watertable - The water table shall be at least four (4) feet below the bottom of the disposal field, except that a lesser depth may be permitted where soil conditions provide adequate protection for groundwater.
 - (a) Borings for determination of perched groundwater and the water table may be required by the Commissioner. In such cases, borings shall be made to a minimum depth of six (6) feet or as site conditions so warrant. Sufficient time shall be provided for stabilization of groundwater before water table elevations are recorded. In sandy soil this may require as little as thirty (30) minutes, while clay soil may require several hours or overnight. Borings shall be located by number on the plat map. Borings shall be conducted during the wettest part of the year and at a time approved by the Commissioner.
- (3) Rock - At sites where surface rock or subsurface rock formations exist to such degree as to affect operational effectiveness of subsurface sewage disposal systems, a sufficient number of borings to a minimum depth of six (6) feet may be required by the Commissioner to determine whether subsurface sewage disposal systems can be expected to give satisfactory service. Such borings shall be located by number on the plat and the results recorded.
 - (a) Rock formations shall be at a depth greater than four (4) feet below the bottom of the disposal field trenches, provided a lesser depth may be permitted where soil conditions so warrant.
 - (b) Rock may be removed in the septic tank excavation if a smooth, firm, level bedding is provided.
- (4) Other Site Considerations:
 - (a) Areas consisting of fill shall be excluded from the area considered for installation of the disposal fields unless soil conditions provide for adequate filtration and will prevent outcropping of sewage effluent.
 - (b) Gullies, ravines, dry stream beds, natural drainage ways, sinkholes, wells, springs, cisterns, streams, areas subject to flooding which have no surface drainage outlet and caves shall be excluded from consideration as usable areas for disposal systems.
 - (c) Sinks shall be considered unsuitable for subsurface sewage disposal unless the following requirements are met:
 - 1. Depth to rock formations must be a minimum of four (4) feet from the surface of the ground, and trench depth shall not exceed thirty (30) inches.
 - 2. Slopes must be thirty (30) percent or less.
 - 3. The area must not be subject to flooding.

4. All other site suitability criteria must be met.
 - (d) Maximum slope permitted for the area to be used for the disposal field shall be determined by the consideration of lateral flow of effluent to the surface of the slope. Slopes of more than thirty (30) percent shall be considered unsuitable unless soil conditions will prevent lateral movement of sewage effluent to the ground surface. Slopes exceeding fifty (50) percent shall be considered unsuitable.
 - (e) Lot Grading - The area to be used for the disposal field shall not be disturbed when grading the lot. However, where this is unavoidable, a re-evaluation shall be made after grading has been completed. After the suitability of any area to be used for subsurface sewage disposal has been evaluated and approved for construction, no change shall be made to this area unless the Commissioner is notified and a re-evaluation of the area's suitability is made prior to the initiation of construction.
 - (f) When soils evaluations indicate the soil absorption rate to be less than ten (10) minutes per inch, a conventional subsurface sewage disposal system shall not be used.
- (5) Soil Improvements
 - (a) Site Requirements
 1. Sites where soil improvement is necessary to change soil absorption rates to the acceptable range shall be considered unsuitable for subsurface sewage disposal until the improvement is adequately noted on the recorded final plat and in addition, noted on the permit at the time of issuance.
 2. Sites where soil protection practices are necessary to maintain soil absorption rates within the acceptable range shall be considered unsuitable for subsurface sewage disposal until the protection practice is adequately noted on the recorded final plat and in addition, noted on the permit at the time of issuance.
 - (b) Design
 1. The improvement and/or protection practices shall be of such location, configuration and construction to adequately collect, remove and discharge by gravity all interfering surface and subsurface water and not to collect sewage or any effluent from a subsurface sewage disposal system.
 2. The minimum trench width of the soil improvement and/or protection practice shall be twelve (12) inches.
 - (c) Material Specifications
 1. The gravel in the improvement and/or protection practices must be of sufficient amount, size and quality to allow storage and free movement of the collected water.

2. If an impermeable barrier is necessary for proper performance of the improvement and/or protection practice, the barrier must be of sufficient strength and durability to withstand the conditions under which it must perform.
3. The collection pipe must have a minimum diameter of four (4) inches, or equivalent, and must be designed to collect groundwater. It must be constructed to withstand the conditions and weights under which it must perform.

Authority: T.C.A. §68-221-403, 4-5 et seq. Administrative History: Original rule certified June 7, 1974. Amendment filed December 21, 1989; effective February 4, 1990. Amendment filed January 9, 1991; effective February 23, 1991. Amendment filed February 3, 1997; effective April 19, 1997. Amendment filed February 3, 1997; effective April 19, 1997. Amendment filed December 27, 2000; effective March 12, 2001. Amendment filed _____, effective _____.

1200-1-6-.04 PERCOLATION TEST PROCEDURES.

- (1) Type of Test Holes - The holes shall be dug or bored, with horizontal dimensions from six (6) to twelve (12) inches and vertical sides to the depth as appropriate for the type of system to be installed and the house that is to be constructed.
- (2) Preparation of Test Holes - Carefully scratch the bottom and sides of the holes with a knife blade or sharp pointed instrument in order to remove any smeared soil surfaces, and to provide a natural soil interface into which water may percolate. Remove all loose material from the holes. Add two (2) inches of coarse sand or fine gravel to protect the bottom from scouring and sediment.
- (3) Conducting the Test - Carefully fill the holes with clear water to a minimum depth of twelve (12) inches over the gravel. No additives shall be used at any time during the percolation test procedures. In most soils, it is necessary to refill the holes by supplying a surplus reservoir of water, possibly by means of an automatic siphon, to keep water in the holes at least four (4) hours and preferably overnight. The measurement period of the test shall begin twenty-four (24) to thirty (30) hours after initial filling.
- (4) Percolation Rate Measurement - Percolation rate measurement shall be made on the day following the procedure described under item (3) and calculations of area required for disposal fields shall be based on Appendix II.
- (5) If greater than six (6) inches of water remains in the test holes after the overnight presoaking period, adjust the depth to approximately six (6) inches over the gravel. From a fixed reference point, measure the drop in water level over a thirty (30) minute period. This drop is used to calculate the percolation rate.
- (6) If six (6) inches, or less, of water remains in the holes after the overnight presoaking period, add clear water to bring the depth of water in the holes to approximately six (6) inches over the gravel. From a fixed reference point measure the drop in the water level at approximately thirty (30) minute intervals for four (4) hours, refilling to approximately six (6) inches over the gravel after each reading. The drop that occurs during the final thirty (30) minute period is used to calculate the percolation rate. The drop that occurs during prior periods provides information for possible modification of the procedure to suit local circumstances.
- (7) Tests shall be conducted by an engineer or surveyor licensed in the State of Tennessee. An approved soil consultant or a registered professional environmentalist registered in

the State of Tennessee may conduct percolation tests if they are not employed by a State, Regional, District, County or Municipal Department of Environment and Conservation.

Authority: T.C.A. §68-221-403, 4-5 et seq. Administrative History: Original rule certified June 7, 1974. Amendment filed May 17, 1978; effective June 16, 1978. Amendment filed December 21, 1989; effective February 4, 1990. Amendment filed January 9, 1991; effective February 23, 1991. Amendment filed February 3, 1997; effective April 19, 1997.

1200-1-6-.05 CONSTRUCTION PERMIT.

- (1) No property owner or installer of a subsurface sewage disposal system shall construct, alter, extend, or repair subsurface sewage disposal systems within the State of Tennessee unless he holds a valid construction permit issued by the Commissioner.
- (2) The Commissioner shall refuse to grant a permit for the construction of a subsurface sewage disposal system where there is an accessible public sewerage system. The recipient of a permit for construction of a subsurface sewage disposal system shall be the responsible person(s) for adhering to the construction requirements of these Regulations.
- (3) These rules also apply in correcting existing failures; however, the Commissioner may allow repairs if the site does not meet the soil suitability; disposal field length and reserve area requirements.
- (4) The construction permit shall have an expiration date effective three (3) years from the date of issuance. All construction permits issued prior to February 4, 1990 shall expire on June 30, 1996.
- (5) Electrical Inspector Notification
 - (a) Any person who intends to construct or locate a house or establishment, mobile or permanent, after June 30, 1994, shall furnish evidence to the official electrical inspector that:
 1. An application for a subsurface sewage disposal system construction permit has been made (on a form provided by the Division of Ground Water Protection), or;
 2. The house or establishment is served by a public sewerage system.
 - (b) Provided however, this shall not apply to farm buildings or other buildings which are not connected to a public sewerage system or a subsurface sewage disposal system.
 - (c) Where an existing subsurface sewage disposal system is to be utilized, a statement shall be provided by the Division of Ground Water Protection (upon notification by the landowner or their agent) that will serve as evidence that the requirements of Tennessee Code Annotated, Section 68-221-414(a) have been met.
 - (d) Where there is an established countywide building permit program, as determined by the Commissioner, or where power is being restored, the provisions of this rule shall not apply.

Authority: T.C.A. §68-221-403(a)(2) and (3) and 68-221-414(f)(1). Administrative History: Original rule certified June 7, 1974. Amendment filed December 21, 1989; effective February 4, 1990.

Amendment filed January 9, 1991; effective February 23, 1991. Amendment filed May 12, 1994; effective July 26, 1994. Amendment filed June 1, 1994; effective August 15, 1994.

1200-1-6-.06 DESIGN OF THE CONVENTIONAL DISPOSAL FIELD.

- (1) The size of the conventional subsurface sewage disposal system shall be determined by the following:
 - (a) The suitability of the site shall be determined by a high or extra high intensity soil map completed by an approved soil consultant and other criteria established by these Regulations. The soil absorption rates that range from ten (10) through seventy-five (75) minutes per inch are acceptable. Soil absorption rates for soil series and phases of soil series that are established in Appendix I shall apply. The absorption rates for soil series and phases that have been recognized by the Natural Resource Conservation Service in Tennessee but not listed in Appendix I shall be established by the department. Rates for soil variants and miscellaneous land types may be established by an approved soil consultant but may require approval by the department.
 - (b) Where percolation tests are conducted the size of the subsurface sewage disposal system shall be determined by the rate found in Appendix II. The minimum square footage of trench bottom installed per bedroom shall be three hundred and seventy (370).
 - (c) On individual lots where the Commissioner determines site suitability, an estimated soil absorption rate up to and including seventy-five (75) minutes per inch may be established. The size of the conventional subsurface sewage disposal system shall be determined by the rate found in Appendix II.
 - (d) Soils with absorption rates greater than seventy-five (75) minutes per inch as determined by a soil evaluation shall be considered unsuitable for conventional subsurface sewage disposal. Soils with percolation rates less than one hundred and six (106) minutes per inch may be used for conventional systems under authority of T.C.A. §68-221-403(c)(1).
- (2) Where conventional subsurface sewage disposal systems are installed, sufficient additional area must be available for the expansion of the disposal field in an amount large enough to install the secondary disposal field as required by these Regulations.
- (3) Design of the disposal field shall be of the recirculating (level lot) or serial distribution type or a modification of either, depending on the characteristics of the site.
 - (a) Recirculating Design - Where the elevation difference in the area utilized for the absorption field does not exceed twelve (12) inches, a recirculating system is preferred. A recirculating design provides equal distribution of the effluent throughout the entire system by connecting successive trenches on both ends and by maintaining the grade in the bottom of these trenches from level to no more than four (4) inches. In this manner, the entire absorption area within the sewage system is utilized concurrently.
 - (b) Serial Distribution - This design is preferred where the elevation difference of the ground surface over the absorption field area exceeds twelve (12) inches. In serial distribution, each adjacent trench is connected to the next by a closed pipe laid on an undisturbed section of ground. The arrangement is such that all effluent is discharged to the first trench until it is filled. Excess liquid is then

carried by means of a closed line (relief line) to the next trench. In this manner, each portion of the subsurface system is used in succession.

(c) Large Conventional Systems - Those exceeding two thousand two hundred and fifty (2,250) square feet of disposal field.

1. When the disposal field exceeds two thousand two hundred and fifty (2,250) square feet of trench bottom in a single system, a properly designed dosing system shall be used for discharging septic tank effluent into the disposal field. The Commissioner shall require design plans by a licensed engineer. The Commissioner may also require:

(i) Prior to design approval, a licensed engineer must agree, in writing, to monitor the installation and construction of the system and upon completion, provide a final set of as built plans encompassing all components of the system and certification that the installation is in accordance with the design specifications.

(ii) Prior to design approval, it shall be the responsibility of the department to review the aforementioned design and notify the engineer, in writing, of approval of the plans, denial of the plans or needed modifications to the plans.

2. When the design daily flow from a single source exceeds three thousand (3,000) gallons per day, siphons or pumps shall be used which shall discharge to separate disposal fields. Each system shall not exceed a design capacity of three thousand (3,000) gallons per day.

3. Discharges from dosing systems shall be designed to maximize the distribution of the effluent throughout the system.

4. Buffer zones shall be required at a frequency and size as determined by a detailed soil/site evaluation.

5. The daily wastewater flow from residences or other similar establishments shall be based upon one hundred and fifty (150) gallons per bedroom per day.

(4) Construction Procedure for Disposal Field

(a) The pipe size from the septic tank to the disposal field or pump chamber shall not be less than three (3) inches in diameter (inside measurement) and shall be of equivalent strength of Schedule 40 PVC except where Rule 1200-1-6-.14 applies. The pipe from the septic tank to the disposal field shall be of sufficient length to rest on undisturbed earth.

(b) Materials and equipment used in subsurface sewage disposal systems shall be those which have specifications outlined in these Regulations.

(c) The disposal field trenches shall follow the ground surface contours so that variations in trench depth will be minimized.

(d) A minimum of six (6) feet of undisturbed earth between adjacent trench walls shall be required.

- (e) Adjacent trenches in a serial distribution system shall be connected with a relief line in such a manner that each trench is completely filled with septic tank effluent to the full depth of the media before effluent flows to a succeeding trench.
- (f) In constructing relief lines, care must be exercised to insure that an undisturbed block of earth remains between trenches. The trench for the relief pipe, where it connects with the preceding absorption trench, shall be dug no deeper than the top of the media. The relief line shall rest on undisturbed earth and backfill must be carefully tamped. This section pertains primarily to a serial distribution system. Pipe for relief lines shall have no perforations and shall have a minimum inside diameter of three (3) inches and shall be Schedule 40 PVC or equivalent. All couplings and/or connections must be accomplished with materials/fittings manufactured specifically for Schedule 40 PVC or equivalent to the point of connection with the pipe in the disposal field and shall provide a secure connection. The lengths of pipe used for relief lines shall not be considered part of the required absorption area.
- (g) The influent and effluent relief lines in each individual trench shall be as far from each other as practical in order to prevent short circuiting.
- (h) Invert of the overflow pipe in the first relief line shall be at least four (4) inches lower than the invert of the septic tank outlet.
- (i) Trenches shall not be excavated when the soil is wet enough to smear or compact easily.
- (j) Media for the disposal fields shall consist of crushed rock, gravel or other suitable material as approved by the department, and shall be size number 2, 3, 4, or 24 coarse aggregate, as defined by ASTM D-448-86. The material shall be free from dust, sand, clay or excessive fines. At least ninety (90) percent of the material must pass a two and one-half (2 1/2) inch screen and not more than five (5) percent may pass a one-half (1/2) inch screen.
- (k) Media for the disposal fields shall extend from at least two (2) inches above the top of the perforated field line pipe to at least six (6) inches below the bottom of the perforated field line pipe (a minimum of twelve (12) inches total).
- (l) The top of the disposal field media shall be below the invert of the tank outlet.
- (m) The media for the disposal fields shall be covered with untreated building paper, a layer of straw at least two (2) inches thick or other material determined to be equivalent by the Commissioner.
- (n) Soil material excavated from trenches should be used in backfilling and should be left mounded over the trenches until initial settling has taken place.
- (o) There shall be a minimum of twelve (12) inches of ground cover over the disposal field media and the maximum shall be thirty-six (36) inches of fill, except for systems designed pursuant to T.C.A. §68-221-403(i).
- (p) The bottom of the trenches and the distribution lines shall have a grade from level to no greater than four (4) inches.

- (q) All pipes (tight lines) under paved areas or under driveways shall be Schedule 40 PVC or equivalent and have a minimum inside diameter of three (3) inches. The lengths of pipe used for relief lines and tight lines shall not be considered part of the required absorption area.
 - (r) The pipe used in the disposal field trenches shall have a minimum diameter of four (4) inches, be perforated with one-half (1/2) inch holes and conform to or exceed the standards of ASTM F-405-82A.
 - (s) The area of the disposal field shall not be used for vehicular traffic or vehicular parking. Dozers, trucks, and other heavy vehicles shall not be allowed to run over the septic tank, field lines or other parts of the system.
 - (t) The maximum length of a single line should not exceed one hundred (100) feet unless conditions require a longer line.
 - (u) The maximum depth of a trench shall be forty-eight (48) inches. The minimum depth shall be twenty-four (24) inches, except for systems designed pursuant to T.C.A. §68-221-403(i).
 - (v) The area of the disposal field shall not be used for any underground utilities.
 - (w) A septic tank must not be bypassed by direct line (laundry, grease, etc.) to field line.
 - (x) Down-spouts shall not be connected to the subsurface sewage disposal system. Down-spouts or other surface water shall be diverted away from the subsurface sewage disposal system.
 - (y) Water lines shall not cross, pass through, or go under the subsurface sewage disposal field. Water lines may cross, but not be located in the same trench with, a tight line leading from a septic tank or dosing tank to a disposal field provided the water line is sleeved in a continuous twenty (20) feet section of Schedule 40 PVC pipe or equivalent (a minimum of ten (10) feet on either side of the tight line) and the water line is a minimum of one (1) foot vertically above the tight line.
- (5) No system shall be covered without the inspection and authorization of the Commissioner.

Authority: T.C.A. §68-221-403, 4-5 et seq.. Administrative History: Original rule certified June 7, 1974. Amendment filed December 21, 1989; effective February 4, 1990. Amendment filed January 9, 1991; effective February 23, 1991; Amendment filed February 3, 1997; effective April 19, 1997. Amendment filed _____, effective _____.

1200-1-6-.07 SEPTIC TANK CAPACITY.

- (1) For residences, the liquid capacity of the septic tank shall be based on the following:

<u>Number of Bedrooms</u>	<u>Capacity in Gallons</u>
2 or less	750
3	900

^aFor each additional bedroom, add two hundred and fifty (250) gallons.

- (2) For facilities other than residences, the net volume or effective liquid capacity below the flowline of a septic tank for flows up to five hundred (500) gallons per day shall be at least seven hundred fifty (750) gallons. For flows between five hundred (500) and fifteen hundred (1500) gallons per day, the capacity of the tank shall be equal to at least one and one-half (1 1/2) days' liquid sewage flow. With flows greater than fifteen hundred (1500) gallons per day the minimum effective tank liquid capacity shall equal one thousand one hundred and twenty-five (1125) gallons plus seventy-five (75) percent of the daily sewage flow; or $V=1125+0.75Q$ where V is the volume of the tank in gallons and Q is the daily sewage flow in gallons. Additional tank volume may be necessary where unusual waste water characteristics are expected from a facility. Expected normal sewage flows may be determined from a list as provided by the department or actual known water usage data for any facility to be served may be used if available.

Authority: T.C.A. §53-2044. Administrative History: Original rule certified June 7, 1974. Amendment filed May 17, 1978; effective June 16, 1978. Amendment filed December 21, 1989; effective February 4, 1990.

1200-1-6-.08 DESIGN OF SEPTIC TANKS.

- (1) A septic tank shall be watertight, structurally sound, and not subject to excessive corrosion or decay. Septic tanks installed after January 1, 1991 shall be of two (2) compartment design. The inlet compartment of a two (2) compartment tank shall be between two-thirds (2/3) and three-fourths (3/4) of the total tank capacity.
- (2) Minimum standards of design and construction of precast reinforced concrete septic tanks:
 - (a) The liquid depth may range from thirty (30) to sixty (60) inches for septic tanks of less than three thousand (3000) gallons capacity and may not exceed seventy-eight (78) inches for septic tanks with a capacity of three thousand (3000) gallons or greater.
 - (b) All tanks shall be manufactured with a partition so that the tank contains two (2) compartments. The partition shall be located at a point not less than two-thirds (2/3) nor more than three-fourths (3/4) the length of the tank from the inlet end. The tank wall thickness must remain not less than two and one half (2 1/2) inches thick throughout the tank except for blockouts or the groove for a slide-in partition. The groove for the slide-in partition shall leave a concrete thickness of not less than two and one-fourth (2 1/4) inches in the tank walls. The partition shall be structurally sound and not subject to excessive corrosion or decay.
 - (c) There shall be three (3) blockouts in the inlet compartment, one (1) on the tank end and one (1) on each sidewall, and a blockout in the partition and the outlet end of the tank. The blockouts for these openings shall leave a concrete thickness of not less than one (1) inch in the tank wall. The blockouts shall be made for a minimum of four (4) inch pipe or a maximum of six (6) inch pipe. In lieu of the partition wall blockout, a four (4) to six (6) inch slot extending at least half way across the width of the tank may be used. The top of the slot shall be located no closer than twelve (12) inches to the liquid level and the bottom of

the slot shall be no lower than four (4) inches below the midpoint of the liquid depth. A four (4) inch diameter, or equivalent, air passage opening in the partition shall be provided above the liquid level of the tank.

- (d) The tees or baffles shall be a minimum diameter of either three (3) inch cast iron soil pipe T branch, three (3) inch cast iron sanitary T branch, three (3) inch cast-in-place baffle, or three (3) inch PVC T branch or equivalent in durability and performance as determined by the Central Office of the Division of Ground Water Protection.
- (e) The inlet invert shall enter the tank at least one (1) inch, preferably three (3) inches, above the liquid level of the tank.
- (f) An inlet tee or baffle shall be provided to divert the incoming sewage downward and extend at least twelve (12) inches below the liquid level.
- (g) The partition tees or baffles and outlet tee or baffle shall extend eighteen (18) inches or one-third (1/3) the liquid depth, whichever is the lesser, below the liquid level of the tank. A tee or baffle shall be provided on the first compartment side of the partition at the same elevation as the outlet tee or baffle unless an intercompartmental connecting slot is utilized as described in (2)(c) of this rule.
- (h) Air space equal to at least twenty (20) percent of the liquid depth shall be provided between the top of the tank and the liquid level.
- (i) Adequate access openings above each tee or baffle must be provided in the tank top. Access shall be provided for cleaning or rodding out of the inlet pipe, and the interconnecting tees or baffles in the partition, for inserting the suction hose for tank pumping, and for entrance of a person if internal repairs are needed after pumping. If the knockouts on the inlet compartment sides of the tank are to be used access to these tees or baffles shall also be provided for cleaning and rodding of the inlet pipe. To accomplish this, it may be necessary to extend the tee so they will be located under an access port or a cleanout must be provided on the inlet line immediately outside the septic tank. A manhole opening shall be provided to each compartment with each having a minimum opening of eighteen (18) inches by eighteen (18) inches as the opening cuts the plane of the bottom side of the top of the tank. All circular shaped manholes shall have a minimum diameter of twenty (20) inches as the opening cuts the plane of the bottom side of the top of the tank. The manhole covers shall be beveled on all sides in such manner as to accommodate a uniform load of one hundred fifty (150) pounds per square foot without damage to the cover or the top of the tank. If the top of the tank is to be multislabs construction, the slabs over the inlet of the tank, partition, and outlet of the tank must not weigh in excess of one hundred fifty (150) pounds each. Multislabs construction must allow for a minimum access hole size of six (6) inches by six (6) inches to each compartment. Manhole covers, opening covers, or slabs shall have a handle of steel or other corrosion resistant material equivalent in strength to a No. 3 reinforcing rod (rebar).
- (j) The tank shall be properly vibrated and rodded prior to curing to eliminate honeycomb.

- (k) The top, bottom, ends, and sides of the tank must have a minimum thickness of two and one-half (2 1/2) inches except for blockouts or the slide in partition groove.
 - (l) After curing, tanks manufactured in two (2) sections shall be joined and sealed at the joint by the manufacturer by using a mastic sealant and/or pliable sealant that is both waterproof and corrosion resistant.
 - (m) Tank Labeling - Precast septic tanks shall be provided with a suitable legend, cast or etched in the wall at the outlet end and within six (6) inches of the top of the tank, identifying the manufacturer by name and address or registered trademark and indicating the liquid capacity of the tank in gallons.
- (3) Plans for prefabricated tanks, other than those for precast reinforced concrete tanks, shall be approved by the department, on an individual basis as determined by the information furnished by the designer which indicates the tank will provide equivalent effectiveness as those designed in accordance with the provisions of section 2 of this rule.
- (4) Septic tanks other than approved prefabricated tanks shall be constructed consistent with the provisions of paragraph (2) of this rule except as follows:
- (a) Cast-in-place concrete septic tanks shall have a minimum wall thickness of six (6) inches.
 - (b) Cast-in-place septic tanks of one thousand (1000) gallons or smaller shall have a minimum top and bottom thickness of four (4) inches.
 - (c) Cast-in-place concrete septic tanks with a capacity of greater than one thousand (1000) gallons shall have a minimum top and bottom thickness of six (6) inches.

Authority: T.C.A. §53-2044. Administrative History: Original rule certified June 7, 1974. Amendment filed December 21, 1989; effective February 4, 1990. Amendment filed January 9, 1991; effective February 23, 1991. Amendment filed June 1, 1994; effective August 15, 1994.

1200-1-6-.09 EFFLUENT TREATMENT DEVICES/SYSTEMS.

- (1) Septic Tank and/or Dosing Tank Filters, Conventional Sand Filters, and Recirculating Gravel Filters may be used to improve the quality of septic tank effluent in an approved subsurface sewage disposal system.

Authority: T.C.A. §68-221-403(a)(2) and 4-5-201 et.seq. Administrative History: Original rule filed February 3, 1997; effective April 19, 1997.

1200-1-6-.10 LOCATION OF SEPTIC TANKS, DOSING CHAMBERS AND ABSORPTION FIELDS.

- (1) The location of septic tank, dosing chamber, and disposal field shall be selected in accordance with the following minimum distances in feet, bearing in mind that local conditions may require increased distances of separation.

	Septic tank and/or Dosing Chamber	Disposal Field
Water Supply	50	50

Dwellings	5	10
Property Lines	10	10
*Gullies, Ravines, Dry Stream Beds, Natural Drainageways, Sinkholes, Streams, and Cut Banks	15	25
Water Lines	10	10
House to Tank Connections	--	10
Septic Tank	--	5

*These distances may increase or decrease as soil conditions so warrant as determined by the Commissioner after a special investigation by an approved soil consultant.

Authority: T.C.A. §68-221-403, 4-5 et seq. Administrative History: Original rule certified June 7, 1974. Amendment filed December 21, 1989; effective February 4, 1990. Amendment filed February 3, 1997; effective April 19, 1997.

1200-1-6-.11 DESIGN OF DOSING SYSTEMS.

(1) Dosing Chamber

(a) The dosing chamber, access riser and riser cover shall be watertight, structurally sound and not subject to excessive corrosion or decay. The dosing chamber shall be of one (1) compartment design. They shall be of such construction and size as specified in Rule 1200-1-6-.08 Sections 2, 3 and 4, excluding those requirements strictly relating to two (2) compartments.

1. The access riser shall have a minimum diameter of twenty-four (24) inches and extend to the finished grade or above. Rectangular or square risers may be allowed provided the size of the opening provides the equivalent access as a circular riser. An access riser with a minimum diameter of sixteen (16) inches may be used provided the threaded union on the pump outlet pipe is located within two (2) feet of the top of the access riser. The access riser shall be located near the outlet end of the tank, directly above the pump or siphon, supply line, switches and other fixtures.

(b) The dosing chamber volume shall be a minimum of two (2) times daily wastewater flow except when an alternate pump equipped with an in-tank supply line and switch assembly is on-site and ready for use. If the alternate pump, in-tank supply line and switch assembly is on-site and ready for use, the minimum dosing chamber volume shall be a total of the volume of water below the static level plus the designed dosing volume plus one-half (1/2) the daily flow.

(2) Design of Pumps, Pipes, and Controls

(a) The gallons per minute (gpm) flow in a dosing system shall be determined by the distribution network it doses. If the distribution network is of such design that the gpm flow is not confined to specific amounts, the minimum flow shall be ten (10) gpm.

(b) Total dynamic head (TDH) shall be determined by adding the following:

1. Elevation head is the difference in elevation between the bottom of the pump and the highest ground elevation at the disposal field. The minimum assigned elevation head shall be five (5) feet.
 2. Friction head shall be determined from Appendix III plus fittings loss.
 3. Pressure head is the amount of pressure desired at the distribution network and shall be a minimum of one (1) foot.
- (c) When pumping uphill, a check valve must be utilized if the volume of effluent which will flow back into the tank exceeds one-fourth (1/4) daily flow.
- (d) The dosing volume shall be between one-fourth (1/4) and one-half (1/2) daily flow, except in those situations where the minimum dose exceeds one-half (1/2) daily flow, then the calculated minimum dose shall be the dosing volume.
- (e) Pipe and Fittings
1. All pipe materials shall be a minimum of Schedule 40 PVC.
 2. All fittings shall be pressure fittings.
 3. All connections shall be adequately cleaned with cleaning solvent and glued with PVC solvent cement.
 4. If used, the gate or globe valve(s) and check valve shall be either bronze or PVC.
 5. The supply line shall be designed and installed to drain after each use unless system design requires a check valve.
- (f) Pump, Float Controls, and Alarm System
1. The pump shall be a good quality, effluent pump and be of sufficient size to meet or exceed the gallons flow requirement and the total dynamic head requirement set forth by the system.
 2. The pump float controls must be adjustable.
 - (i) The controls must be sealed against entry of effluent or gases.
 3. The alarm system.
 - (i) The high water alarm shall be required and consist of an audible and visible alarm located in a visible place and clearly marked "wastewater system alarm."
 - (ii) The alarm and alarm switches shall be placed on a separate electrical circuit from the pump power line.
 - (iii) The alarm float control shall be placed so as to be activated when the pump chamber water level rises above the "pump on" float control.
- (g) Pump and Controls

1. The pump must be placed so that the intake is a minimum of eight (8) inches above the bottom of the pump chamber.
2. As a means to remove the pump from the pump chamber, a material of sufficient strength and durability must be secured to the pump and access riser.
3. The pump control must be positioned so the "pump off" switch is slightly above the top of the pump and the "pump on" switch is at the desired dosing depth. The "pump off" switch for pumps specifically designed to operate with the pump motor casing exposed to air, may be located at a lower elevation provided an adequate depth of wastewater is maintained above the pump intake to insure that the pump intake will not draw in air.
4. The pump outlet pipe must be connected to the supply manifold with a threaded union or similar device.
5. When a disposal system requires a specific pressure head, a PVC or bronze, gate or globe valve shall be placed in the supply line.
6. If the effluent is pumped downhill, a five-thirty seconds (5/32) inch siphon breaker hole must be drilled in the bottom of the supply line inside the pump tank, above the liquid level.
7. All electrical installations shall be installed to meet the current wiring methods of the current edition of the National Electric Code (NEC) adopted by the State Fire Marshall's office.

- (3) Where elevation permits and a dosing siphon is used, it shall be designed in accordance with the minimum dose requirements in this rule and capable of meeting those requirements. It shall be durable, structurally sound and not subject to excessive corrosion or decay.

Authority: T.C.A. §68-221-403, 4-5 et seq. Administrative History: Original rule certified June 7, 1974. Amendment filed December 21, 1989; effective February 4, 1990. Amendment filed January 9, 1991; effective February 23, 1991. Amendment filed September 3, 1991; effective October 18, 1991. Amendment filed June 1, 1994; effective August 15, 1994. Amendment filed February 3, 1997; effective April 19, 1997. Amendment filed _____, effective _____.

1200-1-6-.12 MAINTENANCE OF THE SUBSURFACE SEWAGE DISPOSAL SYSTEM.

- (1) It is the property owner's responsibility to maintain the system in a safe and sanitary manner.
- (2) Should the system malfunction, the Commissioner shall issue, in writing, a maximum thirty (30) day notice to the owner requiring repair, replacement or improvement of the system.

Authority: T.C.A. §53-2044. Administrative History: Original rule certified June 7, 1974. Amendment filed December 21, 1989; effective February 4, 1990. (Formerly numbered 1200-1-6-.10.) Amendment filed February 3, 1997, effective April 19, 1997.

1200-1-6-.13 GREASE TRAPS.

- (1) Grease Traps in Commercial Buildings - Kitchen drain lines from institutions, hotels, restaurants, schools, lunchrooms, and other establishments from which flow a relatively high volume of grease may be discharged to a grease trap. Grease trap effluent shall also be treated in the septic tank before being discharged into the disposal field.
- (2) Grease traps shall be constructed to insure that both the inlet and outlet are properly submerged to trap grease, and that the distance between inlet and outlet is sufficient to allow separation of the grease so that grease solids will not escape through the outlet.
- (3) Grease traps shall be vented so they will not become airborne. A cover shall be provided and located so as to be conveniently accessible for servicing and cleaning. The cover shall be designed to prevent odor and exclude insects and vermin.
- (4) Garbage Grinder Waste - Waste from garbage grinders shall not pass through any grease trap before being discharged to a septic tank.
- (5) Sizing the Grease Trap - Proper sizing of the grease trap should be based on efficiency ratings and flow capacities, which are determined by the number and kinds of sinks or fixtures discharging into the trap.

Authority: T.C.A. §68-221-403, 4-5 et seq. Administrative History: Original rule certified June 7, 1974. Amendment filed May 17, 1978; effective June 16, 1978. Amendment filed December 21, 1989; effective February 4, 1990. (Formerly numbered 1200-1-6-.11.) Amendment filed February 3, 1997; effective April 19, 1997.

1200-1-6-.14 ALTERNATIVE METHODS OF SUBSURFACE SEWAGE DISPOSAL.

- (1) Regarding alternative methods of subsurface sewage disposal, if a conflict occurs between this Rule and other Rules of these Regulations, the items of this Rule shall apply. However, the Commissioner may allow repairs if the site does not meet soil suitability and reserve area requirements. The wastewater flow for residences or other similar establishments served by alternative methods of subsurface sewage disposal shall be based upon one hundred fifty (150) gallons per bedroom per day.
- (2) Large Alternative Subsurface Methods of Sewage Disposal - Any alternative subsurface sewage disposal system that has a wastewater flow greater than six hundred (600) gallons per day, other than a large diameter gravelless pipe system, shall be considered a large alternative subsurface sewage disposal system. A large diameter gravelless pipe system that exceeds seven hundred fifty (750) linear feet of ten (10) inch pipe or eleven hundred twenty-five (1125) linear feet of eight (8) inch diameter pipe shall meet the minimum requirements established in Rule 1200-1-6-.06(3)(c).
 - (a) A site specific design for each large alternative subsurface sewage disposal system shall be submitted to the department for review.
 - (b) The design shall be stamped with the seal of a licensed engineer.
 - (c) Prior to design approval, a licensed engineer must agree, in writing, to monitor the installation and construction of the system and upon completion, provide a final set of as built plans encompassing all components of the system and certification that the installation is in accordance with the design specifications.

(d) It shall be the responsibility of the department to review the aforementioned design and notify the engineer, in writing, of approval of the plans, denial of the plans or needed modifications to the plans.

(3) A Low Pressure Pipe (LPP) system is a subsurface sewage disposal system, which has three basic design principles different from conventional subsurface sewage disposal systems. They are: 1) uniform distribution of effluent, 2) dosing and resting cycles, and 3) shallow placement of trenches. When lots that are less than twenty thousand (20,000) square feet are proposed, the department shall determine the necessity, location and design of buffer zones. LPP systems shall not be used to dispose of wastewater wherein the average concentration of grease exceeds one hundred fifty (150) milligrams per liter (mg/L) because of the clogging potential of the distribution network.

LPP systems designed to accommodate wastewater flows in excess of six hundred (600) gallons per day must be designed by a licensed engineer. The design shall be reviewed by the department applying Rule 1200-1-6-.14(2).

(a) Site and Soil Requirements

1. Prior to the design of the LPP system, the suitability of the site must be demonstrated through acceptable soil absorption rates, acceptable soil conditions and other topographic characteristics. The acceptable soil absorption rate range shall be from ten (10) minutes per inch through seventy-five (75) minutes per inch as determined by an extra high intensity soil map prepared by an approved soil consultant. If the soil absorption rate is determined to be greater than seventy-five (75) minutes per inch based upon the extra high intensity soil map, then percolation tests may be conducted. However, soils with absorption rates in excess of seventy-five (75) minutes per inch due to wetness that cannot be corrected by drainage shall not be eligible for percolation tests. Percolation rates from seventy-six (76) minutes per inch through one hundred twenty (120) minutes per inch are acceptable if no water problems exist.
2. A minimum soil depth of thirty (30) inches over any underlying restrictive horizon is required. However, a modified LPP system may utilize a maximum of six (6) inches of compatible fill, as determined by an approved soil consultant, to obtain the thirty (30) inch depth.
3. Slopes of more than thirty (30) percent shall be considered unsuitable.
4. An area of suitable soil must be available to install the initial system and maintain a suitable area of adequate size for 100% duplication.
5. The size of the LPP system shall be determined by the following:
 - (i) An extra high intensity soil map, provided by a soil consultant approved by the department, shall establish the soil absorption rate.
 - (ii) If the extra high intensity soil map determines that a percolation test is necessary to establish a rate, the percolation holes shall be located in a grid pattern with maximum perpendicular distances between holes of twenty-five (25) feet and the gridded portion shall encompass the entire area to be

utilized for the system and duplicate area. Greater distances may be allowed as determined by the Commissioner. The percolation test procedure in Rule 1200-1-6-.04 of these Regulations shall apply.


- (iii) The daily wastewater flow divided by the loading rate (Table I) shall determine the amount of square footage (area) required for the initial system.
- (iv) Hydraulic overloading of the disposal field may occur when excessive amounts of effluent are distributed over a continuous common slope. Therefore, buffer zones are required if there is more than six (6) feet of elevation difference between the upper and lower laterals or if the distance between the upper and lower laterals exceeds fifty (50) feet. The buffer zone size and the use of soil improvement or soil protection practices are site specific and shall be determined by the Commissioner based on the recommendation of an approved soil consultant. The buffer zone shall not be included as part of the reserve area.


TABLE I. Maximum Loading Rate

Established Rate (mpi)	Loading Rate (gpd/ft ²)
10	.40
20	.40
30	.35
40	.30
45	.275
50	.25
60	.20
75	.15
90	.10
120	.05

(b) Layout of the LPP System

1. The required linear footage is determined by dividing the amount of required square footage of suitable soil area by five (5).
2. The location of the septic tank, dosing chamber, and the disposal field shall be in accordance with Rule 1200-1-6-.10 of these Regulations.
3. The lateral lines shall be placed on contour and lengths shall not exceed those specified in Figure 1.
4. The trench bottom of each lateral shall be at the same elevation throughout that lateral.

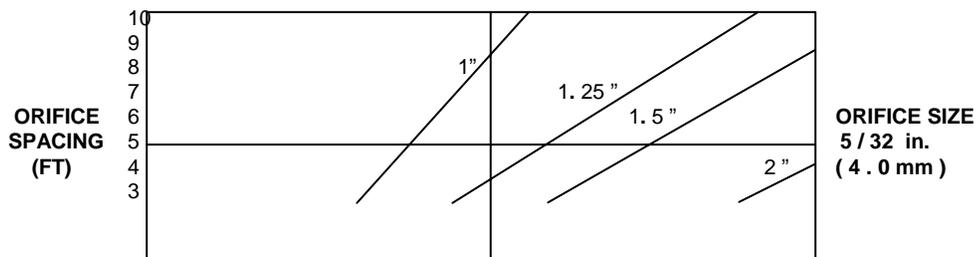

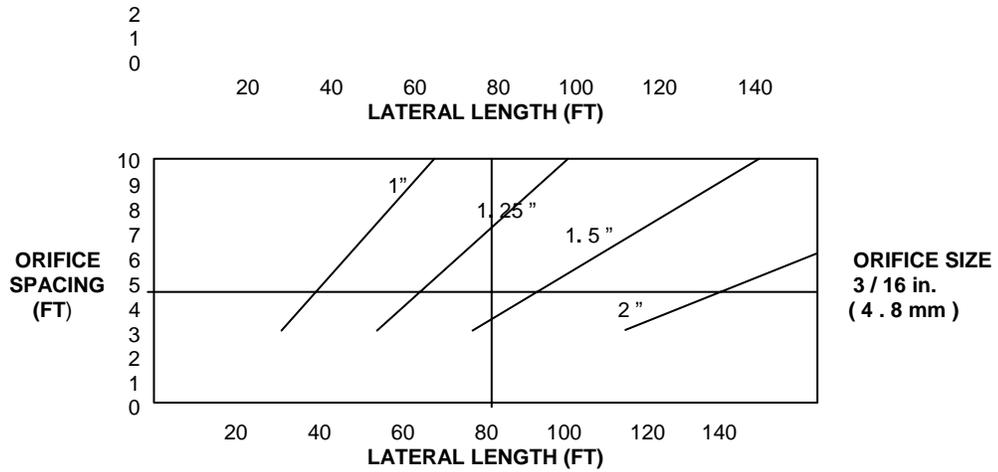

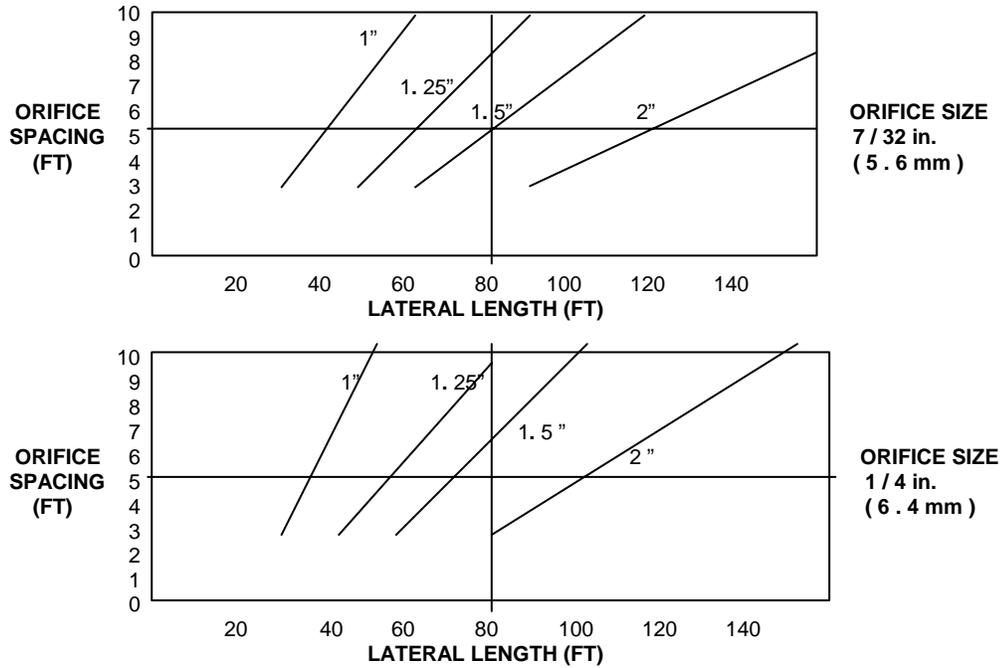


Figure 1. Maximum Length of Different Sized Laterals for Low Pressure Pipe Systems with Varying Orifice Sizes and Spacing (1 ft. = .305 m)

5. The distance between laterals (center to center) shall not be less than five (5) feet.
6. Trench width shall be a minimum of six (6) inches.
7. Trench depth shall range between eighteen (18) and twenty-two (22) inches.
8. A minimum of twelve (12) inches of soil material shall be present between the bottom of the trenches and the restrictive layer.

(c) Dosing and Distribution System Design

1. The dosing rate per linear foot of disposal trench shall be uniform over the entire system. This may be accomplished by varying the hole spacing, hole sizing, or placement of valves in the manifold or laterals to compensate for changes in ground elevation. Table II shall be used to calculate dosing rates.

TABLE II. Pressure Head vs GPM Flow Per Hole

Pressure Head		Hole diameter (in.)		
ft.	psi.	5/32	3/16	7/32
1	.43	.29	.42	.56
2	.87	.41	.59	.80
3	1.30	.50	.72	.98
4	1.73	.58	.83	1.13
5	2.16	.64	.94	1.26

2. The first and last holes in a lateral shall be thirty (30) inches from the ends of the lateral. Hole spacing shall not exceed seven and one-half (7.5) feet.
3. Hole sizes shall be within the range of five thirty-second ($5/32$) inches through seven thirty-second ($7/32$) inches.
4. Calculation of gallons per minute (gpm) flow and total dynamic head.
 - (i) The gallons per minute flow amount which the pump must provide shall be determined by adding the gallons per minute flows per hole over the system dosed by that pump.
 - (ii) The total dynamic head (TDH) shall be determined by adding the following:
 - (I) Elevation head is the difference in elevation between the bottom of the pump and the highest ground elevation at the disposal field. The minimum assigned elevation head shall be five (5) feet.
 - (II) Friction head shall be determined from Appendix III plus fittings loss.
 - (III) A pressure head average of three (3) feet shall be used for TDH calculations. The range shall be one (1) through five (5) feet.
5. When pumping uphill, a check valve must be utilized if the volume of the supply line, manifold, and the volume of the laterals that drain back into the pump tank exceeds one-fourth ($1/4$) daily flow.
6. The minimum dosing volume shall be determined by adding the volume of the supply line, manifold and five (5) times the volume of the laterals. If a check valve is utilized, the minimum dosing volume shall be determined by adding the volume of the manifold and five (5) times the volume of the laterals.
7. The dosing volume shall be between one-fourth ($1/4$) and one-half ($1/2$) daily flow, except in those situations where the minimum dose exceeds one-half ($1/2$) daily flow, then the calculated minimum dose shall be the dosing volume.

(d) Equipment and Material Specifications

1. Septic Tank and Dosing Tank
 - (i) The septic tank shall conform to all design, construction and installation criteria set forth in Rules 1200-1-6-.07 and 1200-1-6-.08.
 - (ii) The dosing chamber shall conform to all design construction and installation criteria set forth in Rule 1200-1-6-.11.

2. Pipe and Fittings

- (i) All pipe materials shall be PVC and have a minimum equivalent strength of Schedule 40.
- (ii) All fittings shall be pressure fittings.
- (iii) All connections shall be adequately cleaned with cleaning solvent and glued with PVC solvent cement.
- (iv) The gate or globe valve(s) and check valve shall be either bronze or PVC.
- (v) The lateral pipe diameter shall be a minimum of one (1) inch.
- (vi) The distal end of each lateral shall be equipped with a capped turnout that provides above-ground access.

3. Pump, Float Controls, and Alarm System

- (i) The pump shall be an effluent pump of sufficient quality and size to meet or exceed the flow requirement and the total dynamic head requirement of the system.
- (ii) The pump float controls must be adjustable and must be sealed against entry of effluent or gases.
- (iii) Alarm System
 - (I) A high water alarm shall be required and consist of an audible and visible alarm located in a visible place and clearly marked "wastewater system alarm."
 - (II) The alarm and switches shall be placed on a separate electrical circuit from the pump power line.
 - (III) The alarm float control shall be placed so as to be activated when the pump chamber water level rises above the "pump on" float control.

4. Disposal Field Media

The disposal field media size shall be within the range of one-half (1/2) to one (1) inch. It must be washed and free of fines.

(e) Installation Procedures

1. Site Preparation and Imported Fill

- (i) The soil area reserved for the initial and duplicate system must not be cut, filled, compacted or disturbed in any manner prior to or after system installation.

- (ii) No site preparation shall occur if the soil is wet. The designated person responsible for monitoring system installation shall determine when the soil is adequately dry.
- (iii) If imported fill is used during installation it must be of compatible material which shall be determined by the soil consultant approved by the department. The area to be filled must be plowed prior to adding fill. The fill material must be applied with a minimum amount of wheeled traffic and must be incorporated to ensure even mixing.

2. Supply Line and Manifold

- (i) The manifold and laterals shall be designed and installed to drain after each use.
- (ii) The supply line shall be designed and installed to drain after each use unless system design requires a check valve.
- (iii) A tee to tee connection between the manifold and laterals shall be used except in situations where the topographic, soil and other site conditions allow the manifold and laterals to be at right angles. If the manifold and laterals are at right angles then crosses or tee to tee connections may be utilized.

3. Distribution Laterals

- (i) The distribution laterals shall be constructed with a minimum disposal field media depth of nine (9) inches, with three (3) inches above the lateral pipe invert.
- (ii) The disposal field media must be covered with untreated building paper, straw or other acceptable material which will allow movement of water and restrict soil movement.

4. Pump and Controls

- (i) The pump must be placed so that the intake is a minimum of eight (8) inches above the bottom of the pump chamber.
- (ii) As a means to remove the pump from the pump chamber, a material of sufficient strength and durability must be secured to the pump and access riser.
- (iii) The pump control must be positioned so the "pump off" switch is slightly above the top of the pump and the "pump on" switch is at the desired dosing depth.
- (iv) The pump outlet pipe must be connected to the supply manifold with a threaded union or similar device.
- (v) A PVC or bronze, gate or globe valve shall be placed in the supply line to adjust the specific pressure head.

- (vi) If the effluent is pumped downhill, a five thirty second (5/32) inch siphon breaker hole must be drilled in the bottom of the supply line above the water level inside the pump tank.
- (vii) All electrical installations shall be installed to meet the current wiring methods of the current edition of the National Electric Code (NEC) adopted by the State Fire Marshall's office.

5. The completed landscape must be shaped to prevent water from ponding or flowing over the system.

- (4) A Mound System is a soil absorption system that is located above the natural soil surface and constructed with suitable fill material. The system differs from the conventional subsurface sewage disposal system in three (3) ways: (1) uniform distribution of effluent, (2) dosing and resting cycles, and (3) above ground construction. When lots that are less than twenty thousand (20,000) square feet are proposed, the department shall determine the necessity, location and design of buffer zones. Mound systems shall not be used to dispose of wastewater wherein the average concentration of grease exceeds one hundred and fifty (150) milligrams per liter (mg/L) because of the clogging potential of the distribution network.

Mound systems designed to accommodate wastewater flows in excess of six hundred (600) gallons per day must be designed by a licensed engineer in accordance with T.C.A. §62-2-101 et seq. The design shall be reviewed by the department applying Rule 1200-1-6-.14(2).

(a) Site and Soil Requirements

1. Prior to the design of the mound system, the suitability of the site must be demonstrated through acceptable soil absorption rates, acceptable soil conditions and other topographic characteristics.
2. The size of the mound system shall be determined by the following:
 - (i) An extra high intensity soil map, provided by a soil consultant approved by the department, shall establish the soil absorption rate.
 - (ii) If the extra high intensity soil map, determines that a percolation test is necessary to establish a rate, the percolation holes shall be located in a grid pattern with the maximum perpendicular distances between the holes being twenty-five (25) feet and the gridded portion shall encompass the entire area to be utilized for the system and duplicate area. Greater distances may be allowed as determined by the Commissioner. The percolation test procedure in Rule 1200-1-6-.04 of these Regulations shall apply.
 - (iii) The daily wastewater flow divided by the infiltrative capacity of medium sand (1.2 gal/ft²/day) shall determine the amount of square footage (area) required for the distribution bed.
3. The requirements relating to rock, groundwater and other site conditions established in Rule 1200-1-6-.03(2), (3) and (4) shall apply. A minimum soil depth of twenty-four (24) inches over any underlying

restrictive horizon is required. However, a modified mound system may utilize up to four (4) inches of additional sand backfill reducing the minimum depth of soil to any underlying restrictive horizon to twenty (20) inches.

4. The acceptable soil absorption rate range for the mound system shall be from ten (10) minutes per inch through seventy-five (75) minutes per inch as determined by an extra high intensity soil map conducted by an approved soil consultant. If the soil absorption rate is determined to be greater than seventy-five (75) minutes per inch based upon a soils map prepared by an approved soil consultant, percolation tests may be conducted. However, soils with absorption rates in excess of seventy-five (75) minutes per inch due to wetness that cannot be corrected by drainage shall not be eligible for percolation tests. Percolation rates from seventy-six (76) minutes per inch through one hundred twenty (120) minutes per inch are acceptable if no water problems exist.
5. An area of suitable soil must be available to install the initial system and maintain a suitable area of adequate size for 100% duplication.
6. If tree stumps, or boulders are present within the areas designated for the initial and duplicate systems, adequate area must be available to compensate for the area occupied by the boulders and tree stumps.
7. The basal area available for a mound must be equal to or greater than the basal area required for a given soil absorption rate.
 - (i) On sloping sites, the basal area available is that area directly below and downslope of the distribution bed. On level sites, the basal area available is that area below and on both sides of the distribution bed. That area below the end slopes shall not be included as available basal area.
 - (ii) The basal area required is determined by dividing the daily flow by infiltrative capacity of the soil. The infiltrative capacity of the following soils shall have the following absorption rates:

<u>Absorption Rate</u>	<u>Infiltrative Capacity Gal./ft.²/day</u>
10-29	1.2
30-60	0.74
61-120	0.24

8. Slopes steeper than twelve (12) percent shall not be utilized. Sites with soil absorption rates of sixty-one (61) through one hundred twenty (120) minutes per inch shall not exceed a slope of six (6) percent.
9. When cluster mounds are used, buffer zones are required at a frequency and size as determined by an extra high intensity soil/site evaluation.

(b) Layout of the Mound System

1. The mound shall be located so as to insure that the distribution bed is situated parallel to slope contour.
2. The location of the septic tank, dosing tank and disposal mound shall be in accordance with Rule 1200-1-6-.10 of these Regulations.
3. The distribution bed shall be constructed level and its thickness shall be constant. A layer of uncompacted straw six (6) inches thick, untreated building paper or acceptable synthetic fabric shall be placed between the distribution bed and the clay cap.
4. Configuration
 - (i) The end slope gradient of the mound shall not be steeper than three (3) horizontal to one (1) vertical. The distance from the gravel bed to the toe of the end slope is calculated by multiplying the average mound height by the horizontal slope figure.
 - (ii) The upslope and downslope gradient of the mound shall not be steeper than three (3) horizontal to one (1) vertical. The distance from the gravel bed to the toe of either the upslope or the downslope side is calculated by multiplying the mound height at the appropriate edge of the gravel bed by the horizontal slope figure and then by the slope correction factor found in Table III.
 - (iii) The distribution bed thickness shall be a minimum of three-fourths (3/4) feet with a minimum of one-half (1/2) feet of aggregate below the distribution network.
 - (iv) The bed width shall not exceed ten (10) feet.
 - (v) The sand fill thickness beneath the gravel bed shall be a minimum of one (1) foot.

TABLE III. Downslope and Upslope Width Corrections for Mounds on Sloping Sites

<u>Slope Percent</u>	<u>Downslope Correction Factor</u>	<u>Upslope Correction Factor</u>
0	1.00	1.00
2	1.06	.94
4	1.14	.89
6	1.22	.86
8	1.32	.80
10	1.44	.77
12	1.57	.73

- (vi) The cap above the distribution bed shall consist of one (1) foot of clayey subsoil at its center tapering to one-half (1/2) foot at its edges.

- (vii) The entire finished mound shall be covered with one-half (1/2) foot of soil material suitable for plant growth.

(c) Dosing and Distribution System Design

1. The dosing rate per linear foot of lateral shall be uniform throughout the entire distribution network.
2. Hole spacing and location shall be such so as to provide uniform distribution of effluent over the entire distribution bed. If the last hole is equal to or greater than one-half (1/2) of the hole spacing distance from the distal end of the lateral, a hole shall be placed in the end cap or adjacent to it.
3. Hole sizing, hole spacing, lateral length and lateral diameter shall be derived from Table IV. The hole diameter shall range from five thirty-second (5/32) through one-fourth (1/4) inch.
4. The system must be designed and placed so that the laterals and manifold drain after each dosing.
5. Calculation of gallons per minute (gpm) flow and total dynamic head (TDH).
 - (i) The gallons per minute flow, which the pump must provide, shall be determined by adding the combined gallons per minute flows of each hole.
 - (ii) The total dynamic head shall be determined by adding the following:
 - (I) Elevation head is the difference in elevation between the bottom of the pump and the laterals in the distribution bed. The minimum assigned elevation head shall be five (5) feet.
 - (II) Friction head shall be determined from Appendix III plus fittings loss.

TABLE IV. Allowable Lateral Lengths (in Feet) for Three (3) Pipe Diameters, Three (3) Perforation Sizes, and Two (2) Perforation Spacings.

Perforation spacing (in.)	Perforation Diameter (in.)	Pipe Diameter		
		(1 in.)	(1-1/4 in.)	(1-1/2 in.)
		feet	feet	feet
30	5/32	42	68	85
	3/16	34	52	70
	7/32	30	45	57
	1/4	25	38	50

36	5/32	45	70	90
	3/16	36	60	75
	7/32	33	51	63
	1/4	27	42	54

(III) A pressure head average of three (3) feet shall be used for TDH calculations. The range shall be one (1) through five (5) feet.

6. The minimum dosing volume shall be determined by adding the volume of the supply line, manifold and five (5) times the volume of the laterals.
7. The dosing volume shall be between one-fourth (1/4) and one-half (1/2) daily flow, except in those situations where the minimum dose exceeds one-half (1/2) daily flow, then the calculated minimum dose shall be the dosing volume.
8. When pumping uphill, a check valve must be utilized if the volume of the supply line, manifold and the volume of the laterals that drain back into the pump tank exceeds one-fourth (1/4) of the daily flow. If a check valve is utilized, the minimum dosing volume shall be determined by adding the volume of the manifold and five (5) times the volume of the laterals.

(d) Equipment and Material Specifications

1. Septic Tank and Dosing Tank

- (i) The septic tank shall conform to all design, construction and installation criteria set forth in Rules 1200-1-6-.07 and 1200-1-6-.08.
- (ii) The dosing chamber shall conform to all design, construction and installation criteria set forth in Rule 1200-1-6-.11.

2. Pipe and Fittings

- (i) All pipe materials shall be PVC and have a minimum equivalent strength of Schedule 40.
- (ii) All fittings shall be pressure fittings.
- (iii) All connections shall be adequately cleaned with cleaning solvent and glued with PVC solvent cement.
- (iv) The gate or globe valve(s) and check valve shall be either bronze or PVC.
- (v) The lateral pipe diameter shall be a minimum of one (1) inch.
- (vi) The distal end of at least one (1) lateral shall be equipped with a capped turnout.

3. Pump, Float Controls and Alarm System

- (i) The pump shall be an effluent pump of sufficient quality and size to meet or exceed the gallons flow requirement and the total dynamic head requirement of the system.
- (ii) The pump float controls must be adjustable and must be sealed against entry of effluent or gases.
- (iii) Alarm System
 - (I) A high water alarm shall be required and consist of an audible and visible alarm located in a visible place and clearly marked "wastewater system alarm."
 - (II) The alarm and switches shall be placed on a separate electrical circuit from the pump power line.
 - (III) The alarm float control shall be placed so as to be activated when the pump chamber water level rises above the "pump on" float control.

4. Disposal Field Media

The media size shall be within the range of one-half (1/2) to one (1) inch. It must be washed and free of fines.

5. Sand

- (i) The particle sizes shall be predominantly (fifty (50%) percent or greater) medium sand (0.50 to 0.25 mm.) with no more than twenty (20%) percent fine sand (0.25 to 0.10 mm.) and be free from silt and clay.
- (ii) The sand shall be composed of stable materials and not subject to chemical deterioration.

6. Clay Cap Above the Distribution Bed - The cap shall be clayey subsoil.

7. Final Cover - The final cover shall consist of non-clayey, friable, fertile soil capable of supporting plant growth.

(e) Installation Procedures

1. Site Preparation and Imported Fill

- (i) The soil area reserved for the initial and duplicate system must not be cut, filled, compacted or disturbed in any manner prior to or after system installation.
- (ii) No site preparation shall occur if the soil is wet. The designated person responsible for monitoring system installation shall determine when the soil is adequately dry.

- (iii) All trees within the area designated for the mound shall be cut to ground level and all excess vegetation shall be removed.
- (iv) The area designated for the mound shall be plowed to a minimum depth of eight (8) inches prior to addition of the sand fill. This area shall be plowed on contour.
- (v) After any area is plowed there shall be no large equipment or wheeled traffic on or over said area. If a small tracked vehicle is used for construction there shall be a minimum of six (6) inches of sand between the track and plowed layer.

2. Supply Line and Manifold

- (i) The manifold and laterals shall be designed and installed to drain after each use.
- (ii) The supply line shall be designed and installed to drain after each use unless the system design requires a check valve.
- (iii) The supply line shall be installed so as to prevent freezing and shall not enter from the downslope side.

3. Pump and Controls

- (i) The pump must be placed so that the intake is a minimum of eight (8) inches above the bottom of the pump chamber.
- (ii) As a means to remove the pump from the pump chamber, a material of sufficient strength and durability must be secured to the pump and access riser.
- (iii) The pump control must be positioned so the "pump off" switch is at the desired dosing depth.
- (iv) The pump outlet pipe must be connected to the supply manifold with a threaded union or similar device.
- (v) Immediately after the union, a gate or globe valve shall be placed in the supply line. The valve may be either PVC or bronze and shall be used to adjust the pressure on the system to the desired head.
- (vi) If the effluent is pumped downhill, a five thirty-second (5/32) inch siphon breaker hole must be drilled in the bottom of supply line above the water level in the pump tank.
- (vii) All electrical installations shall be installed to meet the current wiring methods of the current edition of the National Electric Code (NEC) adopted by the State Fire Marshall's office.

4. The completed system must be shaped to prevent water from ponding or flowing over the system.

(5) Where soil conditions preclude the use of other soil absorption systems, a Waste Stabilization Lagoon may provide satisfactory sewage treatment for residences where soils are not suited for absorption systems and flows are less than six hundred (600) gallons per day. Waste stabilization lagoons require a minimum acreage tract of five (5) acres.

(a) Site and Soil Requirements

1. Prior to the design of the oxidation lagoon, the suitability of the site must be demonstrated through acceptable soil absorption rates, acceptable soil conditions and other topographic characteristics.
2. The soil characteristics shall be determined by a site investigation which includes the following elements.
 - (i) A site plan to a scale of one (1) inch equals fifty (50) feet shall show the four corners of each cell and the four (4) corners of the floor (bottom) of each cell. The four corners of the floor of the proposed lagoon shall be identified with flags or wood stakes.
 - (ii) A minimum of four (4) borings shall be made to a minimum of five (5) feet. One (1) boring shall be made in the floor of the lagoon near each stake or flag.
 - (iii) Additional borings shall be made in the side slopes (walls) of the wetted area of the lagoon to determine that the site has acceptable soil conditions and that the site is free of rocks to a depth of one (1) foot or more below the bottom of the wetted area of the lagoon.
 - (iv) The soil notes shall state the soil color, including mottles; the texture, including coarse fragments and consistence for each layer in the soil.
 - (v) The absorption rate may be estimated by an approved soil consultant but may require approval by the department. Where the estimated absorption rate has been determined to be less than one hundred twenty (120) minutes per inch by an approved soil consultant, absorption rates shall be established by a percolation test. The percolation holes shall be located in a grid pattern with maximum perpendicular distances between holes being twenty-five (25) feet and the gridded portion shall encompass the entire area to be utilized for the system and duplicate area. The percolation test holes shall be dug to a depth equivalent to the total depth of the anticipated oxidation lagoon. The water level shall be adjusted three (3) feet from the bottom of the hole. All other portions of the percolation test procedure in Rule 1200-1-6-.04 of these Regulations shall apply.
 - (vi) The depth of the seasonal high water table shall be noted if it is located within six (6) feet of the soil surface.

3. The soil percolation rate must be a minimum of one hundred twenty (120) minutes per inch.
4. Adequate suitable soil must be available to install the initial system and reserve an area of equal size.
5. The lagoon shall be located in soils where the vertical separation from the bottom of the lagoon and bedrock and rock formations are a minimum of one (1) foot.
6. The minimum operating level of the lagoon shall be located above the seasonal high ground water level. The lagoon shall not be located in areas subject to flooding as determined by the department.
7. Slopes greater than eight (8) percent shall be considered unsuitable.
8. Selection of the site shall include a clear sweep of the surrounding area by prevailing winds. Heavy timber must be removed for a distance of one hundred (100) feet from the water's edge to enhance wind action and prevent shading.
9. Areas consisting of fill shall be excluded from the area considered for installation of the oxidation lagoon and disposal field.
10. Lot Grading - The area to be used for the oxidation lagoon and disposal field shall not be disturbed when grading the lot. However, where this is unavoidable, a re-evaluation shall be made by an approved soil consultant after grading has been completed. After the suitability of any area to be used for an oxidation lagoon has been evaluated and approved for construction, no change shall be made to this area unless the Commissioner is notified and a re-evaluation of the area's suitability is made prior to the initiation of construction.

(b) Location - A minimum acreage tract of five (5) acres is required and larger areas may be necessary.

1. Minimum Separation Distances

- (i) The lagoon shall be located a minimum of fifty (50) feet from property lines, as measured from the lagoon shoreline.
- (ii) The lagoon shall be located a minimum of two hundred (200) feet from the nearest residence, commercial or industrial establishments, any habitable building or public use area. With the owner's permission the lagoon may be within a lesser distance of his home.
- (iii) The lagoon shall not be located closer than fifty (50) feet away from any spring or well. Greater horizontal separation distances may be required depending on engineering and hydrogeological data and type of water supply.
- (iv) The lagoon shall not be closer than fifty (50) feet away from a stream, lake or impoundment.

- (v) The lagoon shall not be located closer than fifty (50) feet from gullies, ravines, dry stream beds, natural drainageways, sinks, caves and cut banks.

(c) Design of the Oxidation Lagoon

1. The capacity of a two (2) cell lagoon shall be equivalent to a sixty (60) day minimum retention time based upon the average daily sewage flow of one hundred and fifty (150) gallons per bedroom for residences. The minimum water surface area of both cells shall be one thousand two hundred and fifty (1,250) square feet.
2. A properly sized and constructed two (2) compartment septic tank shall precede the lagoon.
3. The inner embankment of the lagoon shall be lined with soil, which has a clay content of thirty-five (35) percent or more. The liner shall have a minimum thickness of six (6) inches after compaction.
4. The shape of the lagoon shall be such that there are no narrow or elongated portions. Round, square, or rectangular cells are considered most desirable. Rectangular cells shall have a length not exceeding three (3) times the width. No islands, peninsulas, or coves shall be permitted. Embankments must be rounded at corners to minimize accumulations of floating materials.
5. The embankment top width shall be a minimum of two (2) feet.
6. The embankment slopes shall not be steeper than two (2) horizontal to one (1) vertical on the inner and outer sides.
7. Inner embankment slopes shall not be flatter than three (3) horizontal to one (1) vertical. Outer embankment slopes shall be sufficient to prevent the entrance of surface water into the lagoon.
8. Freeboard (the distance from the top of the water to the top of the embankment) shall be at least two (2) feet after settling. Additional freeboard may be provided.
9. Embankments shall be seeded with a locally hardy grass from the outside toe to the water line, to minimize erosion and facilitate weed control. Alfalfa or similar long-rooted crops which may interfere with the water holding capacity of the embankment shall not be used. Riprap may be necessary under unusual conditions to provide protection of embankments from erosion.
10. On sloping areas, a diversion ditch or soil improvement practices shall be located immediately upslope from the embankment. The ditch or soil improvement practice shall be installed to intercept and remove all surface and subsurface water and shall be protected from erosion.
11. The gravity flow lagoon influent line shall be Schedule 40 PVC or equivalent and have a minimum diameter of three (3) inches with a minimum grade of one-fourth (1/4) inch per foot. When gravity flow is utilized, the outlet invert of the septic tank shall be a minimum of one

(1) foot above the high water level in the lagoon. The water level of each cell shall be at an elevation lower than the original ground surface.

12. The influent line shall be center discharging at a point two (2) feet beneath the water level. A watertight cleanout shall be provided in the influent line near the lagoon embankment and shall extend upwards to finished grade.
13. The effluent line from each cell shall be designed to maintain the water level of that cell at a depth of four (4) feet and be located so as to minimize short-circuiting from the influent line.
14. The effluent from the second cell shall be disposed of by a subsurface sewage disposal system.
15. The subsurface sewage disposal system shall be constructed according to Rule 1200-1-6-.06(4) of these Regulations and shall require a minimum of one hundred and fifty (150) square feet of soil absorption trench bottom area.
16. The finished grade above the subsurface sewage disposal system shall be lower in elevation than the invert of the effluent discharge line from the last cell.

(d) Dosing of the System (applicable only when pumping is necessary).

1. If pumping to the lagoon is necessary, the total dynamic head (TDH) shall be determined by the elevation head, friction head and three (3) feet of pressure head.
2. The gallons per minute (gpm) flow amount, which the pump must provide shall be a minimum of ten (10) gpm.
3. The dosing volume shall be less than one-half (1/2) daily flow.
4. A check valve must be utilized when pumping uphill.

(e) Equipment and Material Specifications

1. Septic tank and dosing tank.
 - (i) The septic tank shall conform to all design, construction and installation criteria set forth in Rules 1200-1-6-.07 and 1200-1-6-.08.
 - (ii) The dosing chamber shall conform to all design, construction and installation criteria set forth in Rule 1200-1-6-.11.
2. Pipe Materials
 - (i) All pipe materials shall be PVC and have a minimum equivalent strength of Schedule 40 PVC.
 - (ii) If pumping is necessary, all fittings shall be pressure fittings.

- (iii) All connections shall be adequately cleaned with cleaning solvent and glued with PVC solvent cement.

(f) Construction

1. The area designated for the lagoon liquid storage area and embankments shall be stripped of vegetation. The organic material removed during excavation of the lagoon shall not be used in embankment construction.
2. The area designated for the lagoon liquid storage area and embankments shall be stripped of soils that will not form an effective seal.
3. The liquid storage area of the lagoon must be sealed to prevent excessive exfiltration.
4. Embankments shall be constructed of impervious materials, and compacted sufficiently to form a stable structure.
5. The influent line shall be installed at sufficient depth to protect the line from freezing and be properly bedded to prevent structural damage to the pipe from wheeled vehicles that cross the area. Slope of the line shall be such that excessive flow velocities do not cause scouring at the discharge point, but shall be adequate to prevent deposition within the line.
6. Effluent from the last cell shall be withdrawn from six (6) inches below the water surface. This shall be accomplished by placing a tee, with the run in a vertical position, on the inlet end of the effluent pipe.
7. The lagoon area shall be enclosed with a minimum four (4) feet high woven or chain-link fence to preclude livestock and discourage trespassing. The fence shall be so located to permit mowing of the embankment top and slopes. A gate of sufficient width to accommodate mowing equipment shall be provided.
8. Appropriate warning signs shall be provided to designate the nature of the facility and discourage trespassing.

(g) Operation and Maintenance

1. It shall be necessary to fill the lagoon with water prior to using it for waste disposal.
2. Vegetation growing along the water's edge and in the water shall be mowed or otherwise removed at least annually.
3. It shall be necessary to maintain a consistent water depth of four (4) feet at all times of the year.

- (6) A Large Diameter Gravelless Pipe (LDGP) system is a subsurface sewage disposal system which has one (1) basic design principle different from conventional subsurface sewage disposal systems, which is that an eight (8) or ten (10) inch inside diameter

corrugated polyethylene perforated pipe is used for the storage and distribution of effluent in a trench in lieu of a four (4) inch diameter pipe and gravel. A filter, fabric wrap around the pipe prevents soil infiltration into the pipe; prevents small, suspended solids from moving out of the pipe; and the pipe volume provides storage capacity equal to or slightly greater than a conventional gravel trench.

LDGP systems that exceed seven hundred fifty (750) linear feet of ten (10) inch diameter pipe or one thousand one hundred and twenty-five (1,125) linear feet of eight (8) inch diameter pipe shall meet the minimum requirements established in Rule 1200-1-6-.06(3)(c).

(a) Site and Soil Requirements

1. The site and soil requirements are the same as for a conventional subsurface sewage disposal system. Where the soil absorption rate exceeds sixty (60) minutes per inch, gravel backfill, leveled with the top of the LDGP, shall be required in accordance with Rule 1200-1-6-.06(4)(j) and (m) and a trench width of twenty-four (24) inches.
2. An area of suitable soil must be available equivalent in size to that necessary to install and duplicate a conventional subsurface sewage disposal system.
3. The size of the LDGP system shall be determined by the following:
 - (i) The soil series shall determine the soil absorption rate found in Appendix I except those series or variants thereof to which a different soil absorption rate has been assigned based on soil properties determined during soil evaluations by a soil consultant approved by the department. The rate found in Table V shall determine the size of the LDGP system. Should a rate not be established for a particular soil series, the rate for that series shall be established by the department.
 - (ii) On individual lots where the Commissioner determines site suitability, an established soil absorption rate up to and including seventy-five (75) minutes per inch may be established. The size of the LDGP system shall be determined by the rate found in Table V.
 - (iii) Where percolation tests are required, the size of the LDGP shall be determined by the rate found in Table V.

TABLE V. Soil Absorption Rates and Corresponding Trench Length Requirements for LDGP Systems

ABSORPTION RATE IN MINUTES PER INCH	TRENCH LENGTH IN LINEAR FEET/GALLON		TRENCH LENGTH IN FEET PER BEDROOM	
	8" Pipe	10" Pipe	8" Pipe	10" Pipe
10	0.600	0.400	83	55
15	0.700	0.467	95	64
30	1.000	0.667	125	84

45	1.250	0.834	150	100
60	1.450	0.967	165	110
75	1.600	1.067	185	124
80	1.650	1.100	190	126
85	1.700	1.134	195	130
90	1.750	1.167	200	134
95	1.800	1.200	208	139
100	1.850	1.234	215	144
105	1.900	1.267	223	149

EXAMPLES:

1. The soil absorption rate is thirty (30) minutes per inch. A three (3) bedroom home is to be located on this site. If an eight (8) inch inside diameter pipe is used, then three (3) bedrooms x one hundred and twenty-five (125) feet/bedroom = three hundred and seventy-five (375) linear feet of trench needed.
2. The soil absorption rate is ninety-five (95) minutes per inch. A four (4) bedroom house is to be located on this site. If a ten (10) inch inside diameter pipe is used, then four (4) bedrooms x one hundred and thirty-nine (139) feet/bedroom = five hundred and fifty-six (556) linear feet of trench needed.
3. The soil absorption rate is forty-five (45) minutes per inch. A commercial building generating five hundred (500) gallons of wastewater per day is to be located on this site. If a ten (10) inch inside diameter pipe is used, then five hundred (500) gallons x eight hundred and thirty-four one thousandths (0.834) feet/gallon = four hundred and seventeen (417) linear feet of trench needed.
4. The soil absorption rate is eighty-five (85) minutes per inch. An industrial plant generating three hundred and seventy-five (375) gallons of wastewater per day is to be located on this site. If an eight (8) inch inside diameter pipe is used, then three hundred and seventy-five (375) gallons x one and seven tenths (1.700) = six hundred and thirty-eight (638) linear feet of trench needed.

(b) Layout of the LDGP System

1. The linear footage required is determined from Table V.
2. The location of the septic tank and the disposal field shall be in accordance with Rule 1200-1-6-.10 of these Regulations.
3. The lateral lines shall be placed on contour. The maximum length of a single line should not exceed one hundred (100) feet unless conditions require a longer line.
4. The trench bottom of each lateral shall have a grade from level to no greater than two (2) inches per one hundred (100) feet.
5. A minimum of six (6) feet of undisturbed earth between adjacent trench walls shall be required.
6. Trench width shall be a minimum of eighteen (18) inches and a maximum of twenty-four (24) inches with the maximum trench width

being required when the soil absorption rate exceeds sixty (60) minutes per inch.

7. Trench depth shall range between twenty-two (22) and forty-eight (48) inches for eight (8) inch pipe and twenty-four (24) and forty-eight (48) inches for ten (10) inch pipe.
8. The large diameter pipe shall be positioned in the trench so that the top location stripe is on top. Sections of pipe shall be securely joined and the filter wrap must cover all joints and the ends of each line. All couplings and/or connections must be accomplished with material/fittings manufactured specifically for large diameter gravelless pipe. Where a supply or tight line ties into the side of a large diameter gravelless pipe, the supply line or tight line shall not penetrate the pipe more than two (2) inches.
9. Soil material excavated from trenches should be used in backfilling and should be left mounded over the trenches until initial settling has taken place.
10. The invert of the overflow pipe in the first relief line shall be at least four (4) inches lower than the invert of the septic tank outlet. The trench for the relief pipe, where it connects with the preceding large diameter gravelless pipe, shall be dug no deeper than the top of the large diameter gravelless pipe. In a recirculating design, the top of the pipe must be a minimum of one (1) inch below the invert of the septic tank outlet.

(c) Equipment and Material Specifications

1. Septic Tank (Rules 1200-1-6-.07 and 1200-1-6-.08 shall apply)
2. Pipe
 - (i) The eight (8) and ten (10) inch inside diameter tubing shall be corrugated polyethylene, meeting the requirements of ASTM F667, Standard Specification for Large Diameter Corrugated Polyethylene Tubing.
 - (ii) Perforations shall be cleanly cut and uniformly spaced along the length of the tubing as follows: two (2) rows of three-eighths (3/8) to one-half (1/2) inch diameter holes located 115⁰ - 125⁰ apart along the bottom half of the tubing with each row of holes 57.5⁰ - 62.5⁰ up from the bottom centerline. These perforations should be staggered so that there is only one (1) hole in each corrugation. Perforations must be located in the minimum diameter portions of the pipe.
 - (iii) The tubing shall be marked with an easily visible top location stripe.
3. Filter Wrap - All large diameter pipe shall be encased with a spun bonded nylon, or other material of similar strength and durability. If the filter wrap is installed at the point of manufacture, then the corrugated pipe and filter

wrap shall be shipped in a protective covering that will prevent damage to the filter wrap. This wrap shall meet or exceed the following general qualities:

<u>Physical Properties</u>	<u>Minimum Values</u>
Weight (oz./sq.yd.)	0.75
Thickness (mils.)	4.4
Grab Strength (lbs.)	
Machine Direction	19
Transverse Direction	11
Burst strength (psi)	26
Air Permeability (cfm/sq.ft.)	500
Water Flow Rate (gpm/sq.ft. at 3" head)	200

(7) A chamber system is a media replacement system consisting of a high density polyethylene arch-shaped open bottomed chamber. Chamber systems that exceed seven hundred fifty (750) linear feet in a single system, or five hundred twenty-five (525) linear feet where the soil absorption rate is sixty (60) minutes per inch or less, shall meet the minimum requirements established in Rule 1200-1-6-.06(3)(c).

(a) Site and Soil Requirements

1. The site and soil requirements are the same as for a conventional subsurface sewage disposal system.
2. An area of suitable soil must be available equivalent in size to that necessary to install and duplicate a conventional subsurface sewage disposal system.

(b) Layout of the Chamber System

1. The size of a chamber system shall be equivalent to the total linear footage required for a three feet wide conventional subsurface sewage disposal system. However, where the soil absorption rate is from ten (10) to sixty (60) minutes per inch, the total linear footage may be reduced by thirty (30) percent. If a portion of a unit is left over after determining the total linear footage required, round up to the nearest whole unit.
2. The location of the septic tank and the disposal field shall be in accordance with Rule 1200-1-6-.10 of these Regulations.
3. The lateral lines shall be placed on contour. The maximum length of a single line should not exceed one hundred (100) feet unless conditions require a longer line.
4. The trench bottom of each lateral shall have a grade from level to no greater than two (2) inches per one hundred (100) feet.

5. A minimum of six (6) feet of undisturbed earth between adjacent trench walls shall be required.
6. Trench width shall be thirty-six (36) inches.
7. Trench depth shall range from twenty-four (24) to forty-eight (48) inches.
8. Soil material excavated from trenches should be used in backfilling and should be left mounded over the trenches until initial settling has taken place.
9. The top of the chambers shall be below the invert of the septic tank outlet.
10. The trench for the relief pipe, where it connects with the preceding absorption trench, shall be dug no deeper than the invert of the opening in the end plate.

(c) Equipment and Material Specifications

1. Septic Tank (Rules 1200-1-6-.07 and 1200-1-6-.08 shall apply)
2. Each chamber shall measure from thirty-two (32) to thirty-six (36) inches wide and ten (10) to twelve (12) inches high. Chambers of varying heights and widths may be approved on an individual basis by the Division of Ground Water Protection Central Office.
3. Each chamber must be designed to interlock with adjacent chambers, inlet plate or end plate forming a complete disposal trench that consists of an inlet plate with a splash plate located below the inlet on the trench bottom and a solid end plate to be located at the distal end of each terminal trench.
4. The chamber sidewall must be designed to allow effluent to pass laterally into the soil.

Authority: T.C.A. §68-221-403, 4-5 et seq. Administrative History: Original rule certified June 7, 1974. Amendment filed May 17, 1978; effective June 16, 1978. Amendment filed December 21, 1989; effective February 4, 1990. Amendment filed January 9, 1991; effective February 23, 1991. Amendment filed September 3, 1991; effective October 18, 1991. Amendment filed June 1, 1994; effective August 15, 1994. Amendment filed February 3, 1997; effective April 19, 1997. Amendment filed December 27, 2000; effective March 12, 2001. Amendment filed _____, effective _____.

1200-1-6-.15 EXPERIMENTAL METHODS OF TREATMENT AND DISPOSAL OTHER THAN THOSE PROVIDED IN THESE REGULATIONS.

- (1) Experimental methods of treatment and disposal of sewage in lieu of those provided herein shall not be utilized unless approval has been granted by the department.
- (2) Prior to issuance of an experimental sewage system permit, a restrictive covenant shall be completed, notarized and recorded at the Register of Deeds Office in the county where the system will be located. A copy of such shall be submitted to the department.

Authority: T.C.A. §68-13-403. Administrative History: Original rule certified June 7, 1974. Amendment filed December 21, 1989; effective February 4, 1990.

1200-1-6-.16 PRIVIES AND COMPOSTING TOILETS.

- (1) Pit privies shall be constructed to prevent a health hazard and prevent insect and rodent accessibility, and shall not be located less than fifty (50) feet from a water supply or less than ten (10) feet from any habitable building or property line.
- (2) Composting toilets must be certified by the National Sanitation Foundation (NSF) to be in compliance with NSF Standard 41, and be published in their "Listing of Certified Wastewater Recycle/Reuse and Water Conservation Devices," before they may be used for disposal of human excreta by non-water carriage methods.
- (3) A pit privy or composting toilet shall not be permitted for a facility where the facility has running water available unless there is an acceptable means to dispose of wastewater.

Authority: T.C.A. §68-221-403, 4-5 et seq. Administrative History: Original rule certified June 7, 1974. Amendment filed May 17, 1978; effective June 16, 1978. Amendment filed December 21, 1989; effective February 4, 1990. Amendment filed June 1, 1994; effective August 15, 1994. Amendment filed February 3, 1997; effective April 19, 1997.

1200-1-6-.17 APPROVED SOIL CONSULTANTS.

- (1) An approved soil consultant shall be one who meets all of the following requirements:
 - (a) Graduation from an accredited college or university with a bachelor's degree in soil science, agronomy and/or agriculture with an emphasis in plant and soil science or agronomy OR graduation from an accredited college or university with a minimum of thirty (30) quarter hours biological, physical and earth sciences and an additional 22.5 quarter hours in soil science.
 - (b) A minimum of two (2) years full time or equivalent of soil evaluation experience in accordance with the United States Department of Agriculture system. Experience must include studies of soil physical characteristics, geology, and soil relationships, soil-landscape relationships, soils identification, landscape features, mapping techniques, interpretive ranges, sewage systems and soil improvement design variations.
 - (c) Candidates must pass a written examination to demonstrate mastery in soil science. A test result of eighty (80) percent correct shall constitute a passing score.
 - (d) Candidate must pass a field soil mapping test to demonstrate mastery in soil classification, soil mapping, soil interpretations and cartography skills. A score of eighty (80) is satisfactory. Candidate then receives interim approval as a soil consultant.
 - (e) After completing the first five (5) soil maps, if no serious errors were made, the candidate then becomes a soil consultant approved to make general and high intensity soil maps.
 - (f) If the candidate fails the written examination, the field test or any of the first five (5) soil maps, the testing procedure may begin again after a six (6) month period. The second time, if the candidate fails the written test, the field mapping

test or any of the first five (5) high intensity soil maps, the testing procedure may begin again after a twelve (12) month waiting period. The testing procedure may be repeated only one time.

- (g) After a period of one year and the completion of a minimum of twenty-five (25) high intensity soil maps with a total of one hundred (100) acres, and approved soil consultant who has not been reprimanded or suspended may apply to become approved to make all intensity soil maps.
- (h) Soil maps shall be made to comply with criteria set forth by the most current edition of "The Soils Handbook For Tennessee" prepared by the Division of Ground Water Protection.

(2) Revocation of Approval

- (a) The department may revoke or suspend the approval of any soil consultant for the practice of any fraud or deceit in obtaining the approval or any gross negligence, incompetence or misconduct in the practice of soil evaluation or any continued disregard of evaluation criteria as required by "The Soils Handbook For Tennessee" prepared by the Division of Ground Water Protection. Any person whose approval as a soil consultant has been denied, suspended, or revoked, may request a hearing before the Commissioner by making such request in writing within thirty (30) days of the date of his denial, suspension, or revocation. Any hearing granted under this section shall be conducted in accordance with the Uniform Administrative Procedures Act, compiled in Title 4, Chapter 5, Part 3 of Tennessee Code Annotated.

Authority: T.C.A. §68-221-403, 4-5 et seq. Administrative History: Original rule certified June 7, 1974. Amendment filed May 17, 1978; effective June 16, 1978. Amendment filed December 21, 1989; effective February 4, 1990. Amendment filed _____, effective _____.

1200-1-6-.18 INSTALLER OF SUBSURFACE SEWAGE DISPOSAL SYSTEMS.

- (1) No person shall engage in the business of constructing, installing, altering, or extending or repairing a subsurface sewage disposal system unless he has a valid annual permit issued by the Commissioner. This section does not apply to the property owner or the property owner's tenant doing his own work on his own property where such property is the residence of the owner or tenant, provided that nothing in this subsection shall act to remove the requirement that any person must secure a construction permit as provided by law and duly promulgated Regulations.
 - (a) Any person who is, on the effective date of these Regulations, or intends to become after the effective date of these Regulations, an installer, shall make application for the installer's permit in writing on a form furnished by the department.
- (2) No permit under this section shall be granted until:
 - (a) An application is filled out in its entirety, unless otherwise specified by the Commissioner; and
 - (b) The installer scores a grade of seventy (70) percent or above on a written or oral test developed by the department. This test requirement does not apply, however, to an installer who was licensed the previous year and who performed satisfactory work, as determined by the Division of Ground Water Protection,

during the previous year. The test shall cover design, location and installation of conventional/alternative subsurface sewage disposal systems; and

- (c) A permit to install subsurface sewage disposal systems may be denied where the applicant has had a previous permit denied, suspended or revoked due to unsatisfactory work, where such unsatisfactory work is material to the subject matter of the permit.
- (3) Permits shall not be transferable or assignable and shall automatically become invalid upon a change of ownership or upon suspension or revocation.
- (4) When a permit has been denied, suspended or revoked, a hearing may be requested before the Commissioner by making such request in writing within thirty (30) days of the date of his denial, suspension, or revocation. Any hearing granted under this section shall be conducted in accordance with the Uniform Administrative Procedures Act, compiled in Title 4, Chapter 5, Part 3 of Tennessee Code Annotated.
- (5) Permits shall expire on the 31st day of December following the date of issuance.
- (6) An application for a permit shall contain the following:
 - (a) Name of business.
 - (b) Business address and phone number.
 - (c) Owner's name.
 - (d) Address and phone number of owner.

Authority: T.C.A. §68-221-403, 4-5 et seq.. Administrative History: Original rule certified June 7, 1974. Amendment filed December 21, 1989; effective February 4, 1990. Amendment filed January 9, 1991; effective February 23, 1991. Amendment filed September 3, 1991; effective October 18, 1991. Amendment filed February 3, 1997; effective April 19, 1997.

1200-1-6-.19 SEPTIC TANK PUMPING CONTRACTOR.

- (1) Domestic Septage Removal Permit - Persons engaged in the business of removing and disposing of domestic septage from septic tanks, holding tanks, portable toilets, or other similar sewage treatment or disposal facilities covered within the provision of these Regulations shall obtain an annual permit from the Commissioner.

Septic tank pumping contractors are authorized under the domestic septage removal permit to pump the contents of grease traps that are a part of subsurface sewage disposal systems. This grease trap waste must be disposed of in a manner approved by the Commissioner. Grease trap waste may not be disposed of on a domestic septage disposal site, as authorized under these Regulations.

- (2) No permit under this section shall be granted until:
 - (a) An application is filled out in its entirety, unless otherwise specified by the Commissioner; and

- (b) The contractor has demonstrated to the Commissioner that he is capable of conducting the operation in accordance with the Regulations as set forth herein.
 - (c) A domestic septage removal permit may be denied where the applicant has had a previous permit denied, suspended or revoked due to unsatisfactory work, where such unsatisfactory work is material to the subject matter of the permit.
- (3) Application for permit shall contain the following:
- (a) Business name, owner's name, address and telephone number.
 - (b) Signature of applicant and date of application.
 - (c) Written permission of the proper official when contents are to be disposed of by discharging into a public or community wastewater treatment plant.
 - (d) Written permission of the landowner, and disposal site operator, if different from the landowner, for each land application site used, including a copy of the domestic septage disposal site permit(s).
 - (e) Tank capacity, in gallons, license number and state of registration for each vehicle used to transport domestic septage.
 - (f) Counties in which the contractor intends to conduct most of his business.
- (4) Monitoring Logs - A monthly log, on a form provided by the Department, of all pumpings and discharges shall be maintained. The log shall include, but not be limited to, the following:
- (a) Date domestic septage is collected.
 - (b) Address of collection.
 - (c) Indicate if collection point is residential or commercial.
 - (d) Volume in gallons collected.
 - (e) Type of waste hauled.
 - (f) The discharge location, by treatment plant name or land disposal site permit number.
 - (g) The date, time and total number of gallons of domestic septage applied to the approved disposal site (if applicable).
 - (h) Method of pathogen reduction and vector attraction reduction for each load (if applicable).
 - (i) The following statement of certification:

"I certify, under penalty of law, that all domestic septage has been disposed of at an approved wastewater treatment facility, or that the site requirements in the Regulations To Govern Subsurface Sewage Disposal Systems, Section 1200-1-6-.20(6) have been met."

- (5) Vehicle Identification - All vehicles engaged in domestic septage removal shall carry on both sides of the vehicle the name and address of the firm or operator conducting the business and the domestic septage removal permit number under which the business is being conducted. All lettering shall be at least two (2) inches high in bold print on a background of contrasting colors. All vehicles used for transporting domestic septage shall have an identifying sticker, provided by the department, attached to the vehicle in a location determined by the department.
- (6) Vehicle Maintenance - Every vehicle used for domestic septage removal purposes shall be equipped with a watertight tank and shall be maintained in a clean and sanitary condition. Liquid wastes shall not be transported in an open body vehicle unless contained within suitable portable receptacles. All pumps, valves and hose lines shall be maintained so as to prevent leakage. A splash plate or other approved method of dispersal shall be used for land application.
- (7) Portable Receptacles - All portable receptacles used for transporting liquid or solid wastes shall be watertight, equipped with tight-fitting lids, and cleaned daily.
- (8) Domestic Septage Removal Permit
 - (a) Permits shall not be transferable or assignable and shall automatically become invalid upon a change of ownership or upon suspension or revocation.
 - (b) Permits shall expire on the 31st day of December, following the date of issuance.
 - (c) When a permit has been denied, suspended, or revoked, a hearing may be requested before the Commissioner by making such request in writing within thirty (30) days of the date of the denial, suspension or revocation. Any hearing granted under this section shall be conducted in accordance with the Uniform Administrative Procedures Act, compiled in Title 4, Chapter 5, Part 3 of Tennessee Code Annotated.

Authority: T.C.A. §68-221-403, 4-5 et seq. Administrative History: Original rule certified June 7, 1974. Amendment filed December 21, 1989; effective February 4, 1990. Amendment filed September 3, 1991; effective October 18, 1991. Amendment filed June 1, 1994; effective August 15, 1994.

1200-1-6-.20 DOMESTIC SEPTAGE DISPOSAL.

- (1) When permission for use is obtainable, a public, or community, or private wastewater treatment facility shall be used to dispose of domestic septage. When permission to use wastewater treatment facilities cannot be obtained, then a permitted domestic septage disposal site may be used in accordance with this rule. A domestic septage disposal site permit shall be obtained from the Commissioner.
- (2) Domestic Septage Disposal Site Permit - Any site used for the disposal of the domestic septage from septic tanks or other sewage treatment or disposal facilities covered within the provisions of these Regulations shall require an annual permit from the Commissioner. The operator of the site shall obtain this permit prior to any use of the site and shall be responsible for the proper use and maintenance of the site.
- (3) No permit under this section shall be granted until:
 - (a) An application is filled out in its entirety, unless otherwise specified by the Commissioner; and

- (b) The operator has demonstrated to the Commissioner that he is capable of operating the site in accordance with the Regulations as set forth herein; and
 - (c) The department has determined that the site meets the minimum requirements as set forth herein.
 - (d) A domestic septage disposal site permit may be denied, suspended, or revoked when the disposal site does not meet the minimum requirements as set forth herein or where it is determined that the operator is not operating the site in accordance with the Regulations as set forth herein.
- (4) Application for permit shall contain the following:
- (a) Business name, address and telephone number of operator.
 - (b) Name, address and telephone number of applicant.
 - (c) Written permission of the landowner. The landowner must agree, in writing, to abide by the land use restrictions as provided in the Regulations.
 - (d) A high intensity soil map of the proposed disposal area prepared in accordance with Rules 1200-1-6-.02(3)(a)(1)(i) and 1200-1-6-.02(3)(a)(2)(i) of these Regulations. This map must note any areas where slope exceeds twelve (12) percent or where there is less than twenty-four (24) inches of soil material before subsurface bedrock formations, fragipans, seasonal high water table, or water are encountered.
 - (e) A plat, with seal and signature of a registered surveyor, of sufficient scale and accuracy to locate pertinent features. This plat shall include, but not be limited to, the property boundaries, disposal boundaries, buildings, underground utilities, roads, surface waters, water supplies, water courses, sinks, sinkholes, caves, etc.
 - (f) The crop to be grown on the disposal site for the coming year.
 - (g) Any additional information that the Commissioner determines is necessary to properly evaluate the site.
- (5) Permits for Domestic Septage Disposal Site.
- (a) Permits shall not be transferable or assignable and shall automatically become invalid upon a change of land or business ownership or upon suspension or revocation.
 - (b) Permits shall expire on the 31st day of December, following the date of issuance.
 - (c) When a permit has been denied, suspended, or revoked, a hearing may be requested before the Commissioner by making such request in writing within thirty (30) days of the date of the denial, suspension, or revocation. Any hearing granted under this section shall be conducted in accordance with the Uniform Procedures Act, compiled in Title 4, Chapter 5, Part 3 of *Tennessee Code Annotated*.

- (6) Land application of domestic septage may be approved as follows:
- (a) The pH of the domestic septage shall be raised to a minimum of twelve (12) or higher by the addition of an alkali such as hydrated lime or quicklime, and without adding more alkali, the domestic septage shall remain at a pH of twelve (12) or higher for at least thirty (30) minutes prior to being land applied; or
 - (b) Domestic septage shall be injected below the surface of the soil. When domestic septage is injected below the surface of the soil, no significant amount of domestic septage shall be present on the surface of the soil within one (1) hour after the domestic septage is injected; or
 - (c) Domestic septage shall be incorporated into the surface of the soil within six (6) hours of land application.
 - (d) The vehicle must be in motion during land application to evenly distribute the domestic septage over the site. A splash plate or other approved method of dispersal shall be used for land application.
 - (e) Grease and/or the contents of grease traps shall not be disposed of at any domestic septage disposal site approved under these rules.
 - (f) Commercial or industrial wastewater shall not be disposed of at any domestic septage disposal site approved under these rules.
 - (g) The contents of portable toilets, Type III marine sanitation devices, or similar materials shall not be applied to domestic septage disposal sites unless the site is approved in conjunction with the Division of Ground Water Protection Central Office.

(7) Site Restrictions

- (a) Soil requirements:
 - 1. Domestic septage disposal sites shall have a slope of twelve (12) percent or less.
 - 2. The soil material in the domestic septage disposal site shall be at least twenty-four (24) inches deep before subsurface rock formations or seasonal ground water is encountered.
 - 3. Domestic septage disposal sites shall have a well-established sod cover unless domestic septage is injected below the soil surface or incorporated into the soil surface within six (6) hours of land application.
 - 4. The minimum soil absorption rate shall be thirty (30) minutes per inch. There are no upper limits on soil absorption rates.
- (b) The annual application rate for domestic septage shall not exceed the annual application rate calculated using the equation:

$$AAR = \frac{N}{0.0026}$$

Where:

AAR = Annual application rate in gallons per acre per 365 day period.

N = Amount of nitrogen in pounds per acre per 365 day period needed by the crop or vegetation grown on the land.

Once the annual application rate has been reached for an approved domestic septage disposal site, no additional domestic septage disposal will be allowed on that site during that calendar year.

- (c) The location of the disposal site shall be selected in accordance with the following minimum distances:
 - 1. Five hundred (500) feet from any habitable building or public use area. With the owner's permission, the site may be within a lesser distance of his residence.
 - 2. One hundred (100) feet from adjoining property, any highway or public road, sink, cave or bedrock outcrop.
 - 3. Three hundred (300) feet from surface waters or any point where it can pollute any water course or groundwater.
 - 4. Five hundred (500) feet from water supplies or bathing areas.
 - 5. No disposal in areas subject to flooding, as determined by the department.
- (d) Grazing restrictions - Animals shall not be allowed to graze on the land for thirty (30) days after application of domestic septage.
- (e) Public access to the domestic septage disposal site shall be restricted for one year after application of domestic septage. Examples of restricted access include remoteness, posting "no trespassing" signs, and/or simple fencing.
- (f) Crop restrictions:
 - 1. Food crops with harvested parts that touch the domestic septage/soil mixture and are totally above ground shall not be harvested for fourteen (14) months after application of domestic septage.
 - 2. Food crops with harvested parts below the surface of the land shall not be harvested for thirty-eight (38) months after application of domestic septage.
 - 3. Animal feed, fiber, and those food crops that do not touch the soil surface shall not be harvested for thirty (30) days after application of domestic septage.

(8) Facility Standards

- (a) Storage facilities shall be identified and approved and must be used if pumping is continued when the site is not accessible or usable.
- (b) Mixing facilities for lime and domestic septage shall be identified, inspected, and approved by the Commissioner.
- (c) Mixing tanks must be watertight, structurally sound, and not subject to excessive corrosion or decay.

Authority: T.C.A. §68-221-403, 4-5 et seq. Administrative History: Original rule certified June 7, 1974. Amendment filed February 3, 1975; effective March 5, 1975. Amendment filed December 21, 1989; effective February 4, 1990. Amendment filed June 1, 1994; effective August 15, 1994. Amendment filed February 3, 1997; effective April 19, 1997.

1200-1-6-21 FEES FOR SERVICES.

(1) Fees for services are assessed pursuant to the following:

<u>Specific Procedure Covered by Fee</u>	<u>Fee</u>
(a) General intensity mapping to determine eligibility for percolation tests.	Eighty (\$80.00) dollars per acre, with Eighty (\$80.00) dollars being the minimum for each separate acre or part of acre to be mapped.
(b) High intensity mapping (sufficient for final approval, 1" = 100' scale) of single lots, or tracts where lots have been staked, or where tracks are gridded (100' grid staking) for residential, commercial, industrial, institutional or recreational users.	Two hundred (\$200.00) dollars per acre, with two hundred (\$200.00) dollars being the minimum for each separate acre or part of acre to be mapped.
(c) Extra-high intensity mapping for alternative disposal system.	Two hundred fifty (\$250.00) dollars per acre with two hundred fifty (\$250.00) dollars being the minimum for each separate acre or part of acre to be mapped.
(d) Conventional, chamber and large diameter gravelless pipe subsurface sewage disposal systems permit application processing, making inspections and other regulatory activities relative to the construction of new conventional, chamber and large diameter gravelless pipe subsurface sewage disposal systems and expansion of system because of additions resulting in added wastewater flow and for repair of malfunctioning systems. Permits shall be granted or denied within forty-five (45) days of receipt of all necessary information.	Two hundred fifty (\$250.00) dollars up to (1,000) gallons per day (g.p.d.) design flow plus one hundred (\$100.00) dollars for each additional (1,000) gallons per day flow, or portion thereof.
(e) Alternative subsurface sewage disposal systems permit application up to (1,000) g.p.d. design flow processing (excluding chamber and large diameter gravelless pipe systems), making inspections and other enforcement activities relative to the construction of alternative subsurface sewage disposal systems and expansion of systems because of additions resulting in added wastewater flow but not for repair of malfunctioning systems. Permits shall be granted	Three hundred (\$300.00) dollars plus one hundred fifty (\$150.00) dollars for each additional (1,000) gallons per day flow, or portion thereof.

or denied within forty-five (45) days of receipt of all necessary information.

- | | | |
|-----|---|---|
| (f) | Experimental subsurface sewage disposal systems permit application processing, making inspections and other enforcement activities relative to the construction of experimental subsurface sewage disposal systems and expansion of systems because of additions resulting in added wastewater flow but not for repair of malfunctioning systems. Permits shall be granted or denied within forty-five (45) days of receipt of all necessary information. | Five hundred (\$500.00) dollars. |
| (g) | Subdivision Evaluation - Evaluations of lots within proposed subdivisions to determine and to specify limitations on their usability for subsurface sewage disposal systems. | Sixty-five (\$65.00) dollars per lot. |
| (h) | Inspections of existing sewage systems. | Two hundred (200.00) dollars per inspection. |
| (i) | Installer and Pumper Permits – Enforcement activities relative to sewage system installers and septic tank pumpers. Permits shall be granted or denied within forty-five (45) days of the date of application. | Two hundred (\$200.00) dollars per permit for pumpers and installers of conventional, and large diameter gravelless pipe systems. An additional (\$100.00) dollars for each type of alternative System to be permitted for. |
| (j) | Sewage Surveys - Activities involved in the inspections and surveying of sewage systems. | Actual costs. |
| (k) | Water Samples - Collection of water samples for bacteriological laboratory analysis but does not include samples collected in enforcement activities. | |
| | (I) Mail Deliver | One hundred fifteen (\$115.00) dollars per sample. |
| | (II) Direct Deliver | Two hundred fifteen (\$215.00) dollars per sample. |
| (l) | Plans Review - Review of designs for large conventional or large alternative subsurface sewage disposal systems to the point of permit issuance. | Six hundred (\$600.00) dollars per proposed system. |
| (m) | Plat approval for individual lots. | Sixty-five (\$65.00) dollars per lot. |
| (n) | Domestic Septage Disposal Site Permit - | Four hundred (\$400.00) dollars. |

- (i) Rule 1200-1-6-.10 applies to subsurface sewage disposal systems. All septic tanks, dosing chambers and absorption fields shall be located in accordance with Rule 1200-1-6-.10.
- (j) Rule 1200-1-6-.11 applies to subsurface sewage disposal systems requiring dosing. All dosing systems shall be designed and installed in accordance with Rule 1200-1-6-.11.
- (k) Rule 1200-1-6-.12 applies to subsurface sewage disposal systems. It shall be the responsibility of the property owner and the Commissioner to adhere to Rule 1200-1-6-.12.
- (l) Rule 1200-1-6-.13 applies to those subsurface sewage disposal systems that utilize grease traps. All grease traps shall be designed, constructed, operated and maintained in accordance with Rule 1200-1-6-.13.
- (m) Rule 1200-1-6-.14 applies to all alternative methods of subsurface sewage disposal. All alternative subsurface sewage disposal systems shall comply with the applicable provisions of Rule 1200-1-6-.14.
- (n) Rule 1200-1-6-.15 applies to experimental methods of subsurface sewage disposal. All experimental methods of subsurface sewage disposal shall comply with Rule 1200-1-6-.15.
- (o) Rule 1200-1-6-.16 applies to privies. All privies shall comply with applicable provisions of Rule 1200-1-6-.16.
- (p) Rule 1200-1-6-.17 applies to all persons who apply for or who are approved soil consultants. Any person applying for or maintaining this approval shall comply with all applicable provisions of Rule 1200-1-6-.17.
- (q) Rule 1200-1-6-.18 applies to all persons who apply for or who have a valid installer of subsurface sewage disposal systems permit. Any person applying for or maintaining this permit shall comply with all applicable provisions of Rule 1200-1-6-.18 at all times.
- (r) Rule 1200-1-6-.19 applies to all persons who apply for or who have a valid septage removal permit. Any person applying for or maintaining this permit shall comply with all applicable provisions of Rule 1200-1-6-.19 at all times.
- (s) Rule 1200-1-6-.20 applies to any person (as defined in Rule 1200-1-6-.01) who disposes of septage and any site which is used for septage disposal. Any person requesting approval to dispose of septage shall comply with all applicable provisions of Rule 1200-1-6-.20. Any site used for disposal of septage shall comply with all applicable provisions of Rule 1200-1-6-.20 at all times.
- (t) Rule 1200-1-6-.21 applies to all services provided by the Division of Ground Water Protection. All applicants requesting a soil map, subsurface sewage disposal system permit, subdivision evaluation, inspection of an existing system, installer or pumper permit, sewage survey, water sample or plan review shall comply with all provisions of Rule 1200-1-6-.22.
- (u) Rules 1200-1-6-.01 through 1200-1-6-.21 apply only to subsurface sewage disposal. They do not include surface discharge systems or holding tanks.

- (2) Severability. If any provision or application of any provision of these rules is held invalid, that invalidity shall not affect other provisions or applications of these rules.

Authority: T.C.A. §68-13-403(a)(2) and Public Chapter 417. Administrative History: Original rule filed December 21, 1989; effective February 4, 1990. Amendment filed January 9, 1991; effective February 23, 1991. Amendment filed September 3, 1991; effective October 18, 1991.

APPENDIX I

Soil Series or Soil Phase	Soil Absorption Rate Min./In. (Average)	Foot Note
Abernathy	30	1
Adaton	>75	2
Adler	30	1
Agee	>75	4
Alcoa	45	
Allegheny	30	
Allen	45	
Alligator	>75	4
Almaville	>75	4
Almo	>75	
Alticrest	30	5
Altavista	30	2
Alva	15	1
Amagon	75	1
Apison	45	5
Arkabutla	45	4
Armour	30	
Armuchee	>75	5
Arrington	30	1
Ashe	15	3
Askew	45	1
Ashwood	>75	3
Atkins	30	4
Augusta	>75	2
Balfour	30	
Barbourville	15	1
Barfield		2
Barger		2
Fragipan>20 inches	75	
Fragipan<20 inches	>75	
Bays	>75	3
Baxter (Cherty)	60	
Beason	>75	2
Bedford		
more than 24 inches to fragipan	75	
less than 24 inches to fragipan	>75	
Beechy	30	4

APPENDIX I (continued)

Soil Series or Soil Phase	Soil Absorption Rate Min./In. (Average)	Foot Note
Bellamy		2
Fragipan>20 inches	75	6
Fragipan<20 inches	>75	
Bewleyville	45	
Bibb	15	4
Biffle	45	5
Biltmore	<10	1
Birds	30	4
Bland	>75	3
Bloomington	>75	4
Bodine (Cherty)	30	
Bolton	45	
Bonair	30	4
Bonn	>75	2
Bosket	30	1
Boswell	>75	
Bouldin	10	
Bowdre	30	4
Bradyville		
more than 20 inches to clay	75	
less than 20 inches to clay	>75	
Brandon	30	
Brantley	>75	
Brasstown	45	
Braxton		
more than 24 inches to clay	75	
less than 24 inches to clay	>75	
Brevard	30	
Briensburg	30	1
Britton	>75	
Brookshire	15	
Bruno	<10	1
Bryson		
more than 24 inches to fragipan	75	2
less than 24 inches to fragipan	>75	2
Buncombe	<10	1
Burgin	>75	2
Burton	30	3
Busseltown		
Fragipan>20 inches	75	6
Fragipan<20 inches	>75	
Byler		
more than 24 inches to fragipan	75	2

APPENDIX I (continued)

Soil Series or Soil Phase	Soil Absorption Rate Min./In. (Average)	Foot Note
less than 24 inches to fragipan	>75	2
Calhoun	>75	2
Calloway	>75	2
Calvin	>75	3
Camp	30	1
Cannon	15	1
Capshaw	>75	2
Captina		
more than 24 inches to fragipan	75	2
less than 24 inches to fragipan	>75	2
Carbo	>75	3
Cataska	>75	
Caylor	60	
Center	75	2
Chagrin	30	1
Chenneby	45	2
Chewacla	30	4
Chickasaw	>75	
Christian	>75	
Citico	45	
Claiborne	45	
Clarksville (Cherty)	30	
Clarkrange		
more than 24 inches to fragipan	75	2
less than 24 inches to fragipan	>75	2
Clifton	45	
Cloudland		
more than 24 inches to fragipan	75	2
less than 24 inches to fragipan	>75	2
Cobstone	15	1
Coghill	>75	5
Coile	>75	5
Colbert	>75	
Collegedale	>75	
Collins	30	1
Commerce	60	4
Conasauga	>75	2
Conagree	15	1
Convent	45	4
Cookeville	60	
Corryton	>75	

APPENDIX I (continued)

Soil Series	Soil Absorption	Foot
-------------	-----------------	------

or Soil Phase	Rate Min./In. (Average)	Note
Cotaco	30	1
Craggey	>75	
Craigsville	15	1
Crevassee	<10	1
Crider	30	
Crossville	30	3
Culleoka	30	5
Cumberland	45	
Curtistown	30	
Cuthbert	>75	3
Cynthiana	>75	3
Dandridge	>75	3
Deanburg	30	
Decatur	45	
DeKalb	15	5
Dekoven	>75	4
Delanco	30	2
Dellrose (Cherty)	30	
Dewey	60	
Dexter	30	
Dickson		
more than 24 inches to fragipan	75	2
less than 24 inches to fragipan	>75	2
Dilton	75	2
Ditney	30	5
Donerail	>75	
Dowelltown	>75	2
Dubbs	45	1
Dulac		
more than 24 inches to fragipan	75	2
less than 24 inches to fragipan	>75	
Dundee	60	4
Dunmore		
more than 24 inches to clay	60	
less than 24 inches to clay	75	
Dunning	>75	2
Dyer	45	4
Eagleville	>75	3
Ealy	15	1
Egam	>75	1
Elk	45	
Elkins	45	4

APPENDIX I (continued)

Soil Series or	Soil Absorption Rate Min./In.	Foot Note
-------------------	----------------------------------	--------------

Soil Phase	(Average)	
Elliber	30	
Ellisville	30	1
Emory	30	1
Enders	>75	
Ennis	30	1
Enville	45	4
Etowah	30	
Eustis	<10	
Eupora	30	4
Evard	45	
Fairmount	>75	3
Falaya	45	4
Falkner	>75	
Fannin	30	5
Farragut		
more than 36 inches to shale material	75	
less than 36 inches to shale material	>75	
Fletcher	45	
Forestdale	>75	4
Fountain	>75	2
Frankstown (Cherty)	45	
Freeland		
more than 24 inches to fragipan	75	2
less than 24 inches to fragipan	>75	2
Fullerton (Cherty)	45	
Fullerton	60	
Gilpin	>75	3
Gladdice	>75	3
Gladeville	>75	3
Godwin	>75	4
Greendale (Cherty)	30	1
Grenada		
more than 24 inches to fragipan	75	2
less than 24 inches to fragipan	>75	2
Groseclose	>75	
Guin	15	
Gumdale	>75	2
Guthrie	>75	4
Guyton	>75	2
Hagerstown	60	
Hamblen	30	1
Hampshire	>75	

APPENDIX I (continued)

Soil Series or Soil Phase	Soil Absorption Rate Min./In. (Average)	Foot Note
---------------------------------	---	--------------

Hanceville	45	
Harpeth	30	
Hartsells	30	5
Hatchie	>75	2
Hawthorne	45	5
Hayesville	45	
Hayter	45	
Hector	>75	3
Hendon		2
Fragipan>20 inches	75	6
Fragipan<20 inches	>75	
Henry	>75	2
Hermitage	30	
Hicks	45	
Hillwood	45	
Hiwassee	45	
Hollywood	>75	2
Holston	45	
Humphreys	30	
Huntington	30	1
Hymon	30	1
Iberia	>75	4
Ina	45	4
Inman	>75	3
Iron City	60	
Iuka	30	1
Jeffrey	30	3
Jefferson	30	
Stoney	15	
Cobbly	15	
Gravelly	15	
Johnsburg	>75	2
Junaluska	45	5
Keener	45	
Landisburg	>75	2
Lanton	>75	1
Lawrence	>75	2
Lax		
more than 24 inches to fragipan	75	
less than 24 inches to fragipan	>75	
Leadvale	>75	2

APPENDIX I (continued)

Soil Series or Soil Phase	Soil Absorption Rate Min./In. (Average)	Foot Note
---------------------------------	---	--------------

Lee	30	4
Leesburg	30	
Lehew	30	5
Lewistown	>75	
Lexington	30	
Lickdale	60	4
Lily	30	5
Lindell	30	1
Lindsay	30	1
Linker	30	5
Litz	>75	3
Lintonia	45	
Lobdell	30	1
Lobelville	30	1
Lomond	45	
Lonewood	60	
Lonon	45	
Loring		
more than 24 inches to fragipan	75	
less than 24 inches to fragipan	>75	
Lost Cove	30	
Lucy	30	
Luverne	>75	
Lynnville	45	4
Magnolia	>75	
Manse	30	
Mantachie	45	4
Marsh	45	3
Masada	30	
Matney	30	3
Maury	45	
Maymead	30	
McCamy	30	3
Melvin	45	4
Memphis	45	
Mercer		
more than 24 inches to fragipan	75	2
less than 24 inches to fragipan	>75	2
Mhoon	60	4
Mimosa	>75	
Minter	>75	4
Minvale	45	
Minvale (Cherty)	30	

APPENDIX I (continued)

Soil Series or Soil Phase	Soil Absorption Rate Min./In. (Average)	Foot Note
Morganfield	30	1

Monongahela		
more than 24 inches to fragipan	75	2
less than 24 inches to fragipan	>75	2
Monteagle	60	3
Montevallo	>75	3
Morehead	>75	4
With drainage	75	
Mountview	45	
Muskingum	60	3
Mullins	>75	4
Muse	>75	
Natchez	60	
Needmore	>75	5
Nella	15	
Nesbitt	75	
Neubert	15	1
Newark	30	4
Nixa		
more than 24 inches to fragipan	75	
less than 24 inches to fragipan	>75	
Noah	75	
Nolichucky	30	
Nolin	30	1
Norene	>75	4
Northcove	30	
Nugent	<10	1
Oaklimeter	30	1
Ocana	15	1
Ochlochkonee	30	1
Oktibbeha	>75	
Oliver	>75	4
Ooltewah	30	1
Opeduon	>75	3
Openlake	>75	1
Orrville	30	4
Pace	75	2
Paden		
more than 24 inches to fragipan	75	2
less than 24 inches to fragipan	>75	2
Pailo	60	
Paraloma		
more than 24 inches to fragipan	75	2
less than 24 inches to fragipan	>75	2

APPENDIX I (continued)

Soil Series or Soil Phase	Soil Absorption Rate Min./In. (Average)	Foot Note
Pembroke	45	

Perkinsville	45	
Petros	>75	3
Pettyjon	45	1
Philo	30	1
Pickaway		
more than 24 inches to fragipan	75	2
less than 24 inches to fragipan	>75	2
Pickwick	60	
Pikeville	45	
Platt	30	
Pope	30	1
Porters	30	5
Potomac	45	1
Prader	45	4
Prentiss		
more than 24 inches to fragipan	75	2
less than 24 inches to fragipan	>75	2
Providence		
more than 24 inches to fragipan	75	2
less than 24 inches to fragipan	>75	2
Pruitton	45	1
Pottsville	>75	3
Purdy	>75	4
Ramsey	>75	3
Ranger	45	5
Red Hills	45	5
Reelfoot	60	4
Renox	45	
Richland		
more than 24 inches to fragipan	75	2
less than 24 inches to fragipan	>75	2
Riverby	15	1
Roane	>75	4
Roanoke	>75	2
Robertsville	>75	4
Robinsonville	15	1
Roellen	>75	2
Rosebloom	45	4
Routon	>75	2
Russellville		
more than 24 inches to fragipan	75	2
less than 24 inches to fragipan	>75	2

APPENDIX I (continued)

Soil Series or Soil Phase	Soil Absorption Rate Min./In. (Average)	Foot Note
Ruston	30	
Saffell	30	

Safford	>75	
Sandhill	15	3
Sango		
more than 24 inches to fragipan	75	2
less than 24 inches to fragipan	>75	2
Savannah		
more than 24 inches to fragipan	75	2
less than 24 inches to fragipan	>75	2
Sees	>75	
Sensabaugh	30	1
Sengtown	60	
Sequatchie	30	1
Sequoia	>75	
Sewanee	30	1
Shack		2
Fragipan>20 inches	75	6
Fragipan<20 inches	>75	
Shady	45	
Shannon	30	1
Shelocta	45	
Sharkey	>75	4
Shouns	60	
Shubuta	75	
Silerton		
more than 24 inches to clay	75	
less than 24 inches to clay	>75	
Skidmore	30	1
Smithdale	30	
Soco	45	5
Solway	>75	3
Spivey	15	
Staser	30	1
State	30	1
Statler	30	1
Steadman	>75	4
With drainage	75	
Steekee	>75	3
Steens	75	2

APPENDIX I (continued)

Soil Series or Soil Phase	Soil Absorption Rate Min./In. (Average)	Foot Note
Stemley		
more than 24 inches to fragipan	75	2
less than 24 inches to fragipan	>75	2
Stiversville	30	

Suches		1
Well drained	45	
Moderately well drained with Subsurface drained	45	
Sugargrove	45	5
Sulphura	>75	3
Sullivan	30	1
Sumter	>75	
Sunlight	>75	3
Susquehanna	>75	
Swafford		
more than 24 inches to fragipan	75	2
less than 24 inches to fragipan	>75	2
Swaim	>75	
Sweatman	>75	
Sykes		
Depth to clay>30 inches	60	
Depth to clay 24 to 30 inches	75	
Depth to clay<24 inches	>75	
Sylco	>75	5
Taft	>75	2
Talbott	>75	3
Talladega	>75	3
Tallant	60	3
Tarklin		
more than 24 inches to fragipan	75	2
less than 24 inches to fragipan	>75	2
Tasso		
more than 24 inches to fragipan	75	
less than 24 inches to fragipan	>75	
Tate	30	
Teas	>75	3
Tellico	45	
Tichnor	>75	4
Tickfaw	>75	4
Tigrett	30	1
Tilsit		
more than 24 inches to fragipan	75	2
less than 24 inches to fragipan	>75	2

APPENDIX I (continued)

Soil Series or Soil Phase	Soil Absorption Rate Min./In. (Average)	Foot Note
Tioga	10	1
Tippah		
more than 24 inches to clay	75	
less than 24 inches to clay	>75	

Tiptonville	45	1
Toccoa	>75	1
With drainage	30	
Tooterville	>75	4
Townley	>75	5
Trace	45	1
Transylvania	15	1
Trappist	>75	5
Tsali	>75	5
Tunica	>75	4
Tupelo	>75	2
Tuscumbia	>75	4
Tusquitee	30	
Tyler	>75	2
Una	>75	4
Unaka	30	5
Unicoi	>75	3
Upshur	>75	
Urbo	>75	
Vacherie	>75	4
Vaiden	>75	2
Vicksburg	30	1
Wakeland	45	4
Wallen	45	5
Watauga	30	5
Waverly	45	4
Waynesboro	60	
Waynesboro Gravelly	30	
Weaver	30	1
Wehadkee	45	4
Welchland	15	1
Wellston	75	
Weon	>75	
Whitesburg	45	1
Whitwell	45	2
Wilcox	>75	
Woodmont	>75	2
Wolftever	>75	2

APPENDIX I (continued)

Soil Series or Soil Phase	Soil Absorption Rate Min./In. (Average)	Foot Note
Woolper	>75	
Worthen	30	
Wynnville		
more than 24 inches to fragipan	75	2
less than 24 inches to fragipan	>75	2

FOOTNOTES

1. Flooding or standing water during brief periods of high rainfall make many areas of these soils unsuitable even though the absorption rate is favorable. Areas protected from flooding or otherwise not subject to flooding may be suitable. These are dominantly well drained and moderately well drained soils along rivers and streams.
2. A seasonally high watertable due to position in landscape and/or soil properties make most areas of these soils unsuitable.
3. Depth to bedrock is generally not sufficient to accommodate a septic tank system. There are some spots of these soils with adequate depths.
4. Flooding and/or a seasonally high watertable make these soils unsuitable sites for subsurface sewage disposal systems. Areas protected from flooding and/or artificially drained may be suitable.
5. Depth to bedrock is generally sufficient to accommodate a filter field system. There are some spots of these soils with inadequate depths.
6. Depths equal to or less than 24 inches and equal to or greater than 20 inches shall be used on extra high intensity soil maps only.

APPENDIX II

SOIL ABSORPTION/PERCOLATION RATES AND CORRESPONDING
ABSORPTION AREA REQUIREMENTS

<u>ABSORPTION/PERCOLATION RATES IN MINUTES PER INCH</u>	<u>ABSORPTION AREA SQ. FT./GAL.</u>	<u>(AS TRENCH BOTTOM RATES AREA) SQ. FT./BEDROOM</u>
10	1.2	165
15	1.4	190
30	2.0	250
45	2.5	300
60	2.9	330
75	3.2	370
80	3.3	380
85	3.4	390
90	3.5	400
95	3.6	415
100	3.7	430
105	3.8	445

NOTE: Round percolation rates to next highest increment of five (5).

NOTE: Trenches of two (2) to three (3) feet in width are preferred. For trenches greater than three (3) feet in width, increase absorption area by the following factors:

<u>Trench Width</u>	<u>Factor</u>
4	1.33
6	1.50
8	1.60

- EXAMPLES:
- The soil absorption rate is fifteen (15) minutes per inch. A factory with a daily flow of three thousand (3,000) gallons is to be located on this site. Three thousand (3,000) gal. x one point four (1.4) sq. ft./gal. = four thousand two hundred (4,200) sq. ft. If a two (2) ft. width trench is used, four thousand two hundred (4,200) sq. ft. ÷ two (2) = two thousand one hundred (2,100) linear feet needed.
 - The soil absorption rate is thirty (30) minutes per inch. A four (4) bedroom house is to be constructed. Two hundred and fifty (250) sq. ft./bedroom x four (4) bedrooms = one thousand (1,000) sq. ft. If a three (3) ft. width trench is used, one thousand (1,000) square ft. ÷ three (3) = three hundred and thirty-three point three (333.3) linear ft. needed.

NOTE: Flow rates for non-residential establishments will be based on the memo from Kent D. Taylor to the Division of Ground Water Protection Field Office Managers dated July 8, 1993, regarding expected sewage flow from non-residential establishments.

APPENDIX III

FRICITION LOSS, IN FEET, THROUGH 100 FEET OF SCHEDULE 40 PVC PIPE

Flow (GPM)	----- Pipe Diameter (in.) -----						
	1"	1 1/4"	1 1/2"	2"	3"	4"	6"
1	.09						
2	.32	.09					
3	.68	.18	.08				
4	1.17	.31	.14				
5	1.76	.46	.22	.06			
6	2.47	.65	.31	.09			
7	3.28	.86	.41	.12			
8	4.20	1.10	.52	.15			
9	5.22	1.37	.65	.19			
10	6.35	1.67	.79	.23			
11	7.57	1.99	.94	.28			
12		2.34	1.10	.33			
13		2.71	1.28	.38			
14		3.11	1.47	.43	.06		
15		3.54	1.67	.49	.07		
16		3.98	1.88	.56	.08		
17		4.46	2.10	.62	.09		
18		4.95	2.34	.69	.10		
19		5.47	2.58	.77	.11		
20		6.02	2.84	.84	.12		
25			4.29	1.27	.19		
30			6.02	1.78	.25	.07	
35				2.37	.35	.09	
40				3.03	.44	.12	
45				3.77	.55	.15	
50				4.58	.67	.18	
60				6.42	.94	.25	
70					1.25	.33	
80					1.60	.43	.06
90					1.99	.53	.07
100					2.41	.64	.09
125					3.65	.97	.13

APPENDIX III (continued)

FRICITION LOSS, IN FEET, THROUGH 100 FEET OF SCHEDULE 40 PVC PIPE

Flow (GPM)	----- Pipe Diameter (in.) -----						
	1"	1 1/4"	1 1/2"	2"	3"	4"	6"
150					6.11	1.36	.19
175					6.80	1.81	.25
200						2.32	.32
225						2.88	.39
250						3.50	.48
275						4.18	.57
300						4.91	.67
325						5.69	.77
350						6.53	.89
375						7.41	1.01
400							1.14
425							1.27
450							1.41
475							1.56
500							1.72
550							2.05
600							2.40
650							2.79
700							3.20
750							3.63
800							4.09
850							4.58
900							5.09
950							5.63

Notes: 160 PSI pipe assumed to be SDR 26.

Computed by the Hazen Williams Formula, assuming C = 140:

$$h_f = \frac{0.00113LQ^{1.85}}{D^{4.87}}$$

h_f = head loss (feet)

L = pipe length

Q = flow (GPM)

D = pipe inside diameter (inches)

Rulemaking Authority: T.C.A. §§68-221-403, 4-5-201 et seq.

The rulemaking hearing rules set out herein were properly filed in the Department of State on the 17th day of November, 2005 and will become effective on the 31st day of January, 2006.